



181 US Hwy 46
Mine Hill, NJ 07803
(908) 654-8068
(800) 783-0567
Fax 908-654-8069

LEAD IN DRINKING WATER REPORT

Performed At:

Pleasantville Public Schools
Pleasantville, New Jersey

Performed For:

Pleasantville Board of Education
801 Mill Rd
Pleasantville, New Jersey 08232

Prepared By:

LEW Corporation
181 US Hwy 46
Mine Hill, NJ 07803

Phone (908) 654-8068
Fax (908) 654-8069
Website <http://www.LEWCorp.com>

Inspection Date: 12/9-10/17
Project Number: 171324

Table of Contents

Contact Information	3#
Introduction	4#
Sampling Methodology	4#
Drinking Water Results	5#
Recommendations	6#
Additional Recommendations	6#

Appendices


Appendix A	Exceedances
Appendix B	Recommendations
Appendix C	All results
Appendix D	Floor Plan(S)
Appendix E	Laboratory Data

Contact Information

Agency

Client Contact:	Mark Delcher
Client Name:	Pleasantville Board of Education
Street Address:	801 Mill Rd, Pleasantville, New Jersey 07232
Phone Number:	609-674-6924

Risk Assessor(s)

Site Assessor(s):	Raheen Holland
License:	NJDOH #013217
Signature:	
Date:	January 17, 2018
E-Mail:	Rholland@lewcorp.com

Firm

Organization:	LEW Corporation
Certification #:	NJDCA 00015 E
Street:	181 US Hwy 46
City, State & Zip:	Mine Hill, NJ 07803
Phone Number:	908-654-8068
Web Address:	http://www.lewcorp.com

Laboratory

Organization:	Environmental Hazard Services, LLC
Street:	7469 Whitepine Road
City, State & Zip:	Richmond, VA 23237
NJDEP Certification #	VA008
Phone Number:	800-347-4010

Introduction

LEW Corporation was contracted by Pleasantville Board of Education to test for the presence of lead in drinking water in six schools in the district.

Sampling Methodology

LEW Corporation followed the July 13, 2016 amendments to NJAC 6A:26. Full details on sampling practices can be found in Districts Sampling Plan.

All samples were collected in 250mL wide mouth plastic containers that was prepackaged by the analytical laboratory. The sample containers may contain nitric acid, if expedited analysis is required. If not, nitric acid will be added to each sample upon arrival at the laboratory. At each sample location, the first draw sample was taken after it was determined that the water had been standing in the plumbing system for greater than eight hours but less than forty-eight hours. If second draw samples were collected, they were collecting following a flushing protocol outlined in the District's Sampling Plan.

Drinking Water Results

December 9-10, 2017, LEW Corporation collected the following number of water samples:

Decatur Ave School

- 5 first draw samples collected
- 1 samples above the 15ppb action level

Washington Ave School

- 13 first draw samples collected
- 2 samples above the 15ppb action level

Leeds Ave School

- 36 first draw samples collected
- 1 samples above the 15ppb action level

N. Main St School

- 11 first draw samples
- 1 samples above the 15ppb action level

S. Main St School

- 32 first draw samples
- 0 samples above the 15ppb action level

Pleasantville Middle School

- 45 first draw samples
- 2 samples above the 15ppb action level

Pleasantville High School

- 55 first draw samples
- 3 samples above the 15ppb action level

The complete list of samples that exceeded the 15ppb limit can be found in Appendix A. The complete list of all sample results can be found in Appendix C. The laboratory results can be found in Appendix E.

Certain outlets could not or were not tested due to various reasons. The following table lists those locations and the reason why samples were not collected.

School	Sample Location	Reason for not testing.
Washington Ave School	Nurse Office	Only Bathroom Sink
Washington Ave School	Conference Rm	Water Dispenser
N. Main St School	Room #121	Sink Only
N. Main St School	Room #119	Not Functional
N. Main St School	Room #120	Broken + Bottle Water in Room

N. Main St School	Room #118	Not Functional
N. Main St School	Room #117	Capped Off
N. Main St School	Room #116	Capped Off
N. Main St School	Room #112	Bottle Water In Room
N. Main St School	Room #110	Bottle Water In Room
N. Main St School	Room #109	Very Low Flow Rate
N. Main St School	Room #104	Bottle Water In Room
N. Main St School	Room #102	Not Functional
S. Main St School	Room #112	Not Functional
S. Main St School	Room #219	Very Low Flow Rate
S. Main St School	Room #208	Not Functional
Pleasantville High School	Room A105	Not Functional

Recommendations

Those outlets where the first draw sample tested below 15ppb are not considered to be elevated and no mitigation is necessary.

For those outlets where the first draw sample exceeds 15ppb the following steps are recommended:

- 1) Immediately discontinue use of the outlets.
- 2) Conduct second draw (flush) samples on these outlets to further delineate source of contamination.

A complete list of recommendations per outlet can be found in Appendix B.

Additional Recommendations

- 1) Follow-up samples should be collected after any remediation efforts in order to determine the efficacy of the work.
- 2) Any of the inoperable/non-functioning outlets listed above that are brought back into service should be sample.
- 3) Comply with all requirements set forth in NJAC 6A:26.

Appendix A Exceedances

Appendix B Recommendations

Pleasantville Public Schools Water Sampling
Recommendations

Building	Location	Remediation Recommendation
Decatur Ave School	Kitchen -Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
Washington Ave School	Kitchen- Prep Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
Washington Ave School	Kitchen -SK	Discontinue use of outlet. Conduct 2nd draw sampling.
Leeds Ave School	Room #207 -Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
N. Main St School	Room #124 -S/F	Discontinue use of outlet. Conduct 2nd draw sampling.
Pleasantville Middle School	Room C205A -Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
Pleasantville Middle School	Room B102C-Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
Pleasantville High School	Room A104 -Sink	Discontinue use of outlet. Conduct 2nd draw sampling.
Pleasantville High School	Outside Rm A103 Lft -WC	Discontinue use of outlet. Conduct 2nd draw sampling.
Pleasantville High School	Outside Rm A103 Rgt -WC	Discontinue use of outlet. Conduct 2nd draw sampling.

Appendix C All Results

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Decatur Ave School	12/9/2017	12/19/2017	115-1	Outside Café -WC	1.90
Decatur Ave School	12/9/2017	12/19/2017	115-2	Kitchen -S	19
Decatur Ave School	12/9/2017	12/19/2017	115-3	Outside Teachers Lounge -WC	<1.00
Decatur Ave School	12/9/2017	12/19/2017	115-4	Nurse Office -NS	4.27
Decatur Ave School	12/9/2017	12/19/2017	115-5	Outside Main Office -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-2	Main Office -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-4	Outside Room 105B Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-5	Outside Room 105B Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-6	Faculty Room -S	4.79
Washington Ave Schd	12/9/2017	12/19/2017	225-7	Outside Electric Room Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-8	Outside Electric Room Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-9	Gym -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-10	Café Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-11	Café Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-12	Kitchen -Prep Sink	15.90
Washington Ave Schd	12/9/2017	12/19/2017	225-13	Kitchen -SK	229
Washington Ave Schd	12/9/2017	12/19/2017	225-14	Outside Art Room Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-15	Outside Art Room Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-1	Room #118 Lft -S	1.23
Leeds Ave School	12/9/2017	12/28/2017	100-2	Outside Room #114 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-3	Room #113 -S	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-4	Room #110 -S	2
Leeds Ave School	12/9/2017	12/28/2017	100-5	Outside Room #108 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-6	Outside Room #126 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-7	Outside Room #100 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-8	Outside Main Office -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-9	Nurse Office -NS	1.04
Leeds Ave School	12/9/2017	12/28/2017	100-10	Nurse Office Back -NS	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-11	Main Office Kitchen -S	4.91
Leeds Ave School	12/9/2017	12/28/2017	100-12	Main Office By Oven -S	6.48
Leeds Ave School	12/9/2017	12/28/2017	100-13	Room #207-S	15.40
Leeds Ave School	12/9/2017	12/28/2017	100-14	Outside Room #204-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-15	Outside Room #201 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-16	Room #308 -WC	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Leeds Ave School	12/9/2017	12/28/2017	100-17	Outside Room #310 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-18	3rd Flr Boys & Girls Bath -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-19	Outside Rm #300 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-20	Gym Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-21	Gym Rgt -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-22	Kitchen -SK	7.76
Leeds Ave School	12/9/2017	12/28/2017	100-23	Kitchen Middle -S	9.6
Leeds Ave School	12/9/2017	12/28/2017	100-24	Kitchen Back Wall -S	10.5
Leeds Ave School	12/9/2017	12/28/2017	100-25	Outside Café -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-26	Teachers Lounge -S	5.29
Leeds Ave School	12/9/2017	12/28/2017	100-27	Outside Storage Rm A Lft-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-28	Outside Storage Rm A Rgt-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-29	Room #403 -S/F	4.15
Leeds Ave School	12/9/2017	12/28/2017	100-30	Room #401 -S/F	1.68
Leeds Ave School	12/9/2017	12/28/2017	100-31	Room #402 -S/F	1.83
Leeds Ave School	12/9/2017	12/28/2017	100-32	Room #404 -S/F	2.02
Leeds Ave School	12/9/2017	12/28/2017	100-33	Main Lobby Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-34	Main Lobby Rgt -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-35	Outside Rm #200 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-36	Outside #304 -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-2	Room #122 -S/F	5.57
N. Main St School	12/9/2017	12/18/2017	175-8	Outside Rm #115 -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-13	Outside Rm #104 -WC	7.37
N. Main St School	12/9/2017	12/18/2017	175-15	Room #101 -S/F	8.34
N. Main St School	12/9/2017	12/18/2017	175-16	Room #123 -S/F	5.44
N. Main St School	12/9/2017	12/18/2017	175-17	Nurse Office -NS	7.66
N. Main St School	12/9/2017	12/18/2017	175-18	Faculty Rm -S	2.29
N. Main St School	12/9/2017	12/18/2017	175-19	Room #124 -S/F	57.10
N. Main St School	12/9/2017	12/18/2017	175-20	Outside Muti-Purpose Rm -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-21	Muti Purpose Rm -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-22	Kithen -S	1.45
S. Main St School	12/9/2017	12/19/2017	701S-1	Room #121 -S/F	5.55
S. Main St School	12/9/2017	12/19/2017	701S-2	Room #124 -S/F	2.47
S. Main St School	12/9/2017	12/19/2017	701S-3	Room #120 -S/F	5.59


Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
S. Main St School	12/9/2017	12/19/2017	701S-4	Main Office -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-5	Nurse Office -NS	4.04
S. Main St School	12/9/2017	12/19/2017	701S-6	Nurse Office -NS	2.96
S. Main St School	12/9/2017	12/19/2017	701S-7	Room #128 -S/F	2.21
S. Main St School	12/9/2017	12/19/2017	701S-9	Room #129 -S/F	13.90
S. Main St School	12/9/2017	12/19/2017	701S-10	Outside Rm #110 -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-11	Outside Rm #106 Lft -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-12	Outside Rm #106 Rgt -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-13	Outside Rm #102 -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-14	Café Lft -WC	1.01
S. Main St School	12/9/2017	12/19/2017	701S-15	Café Rgt -WC	1.04
S. Main St School	12/9/2017	12/19/2017	701S-16	Kitchen -S	5.14
S. Main St School	12/9/2017	12/19/2017	701S-17	Kitchen SK	4.16
S. Main St School	12/9/2017	12/19/2017	701S-18	Gym -WC	5.21
S. Main St School	12/9/2017	12/19/2017	701S-19	Outside Faculty Lounge Lft-WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-20	Outside Faculty Lounge Rgt-WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-21	Faculty Lounge -S	4.21
S. Main St School	12/9/2017	12/19/2017	701S-22	Room #201 -S/F	6.98
S. Main St School	12/9/2017	12/19/2017	701S-24	Room #202 -S/F	3
S. Main St School	12/9/2017	12/19/2017	701S-25	Room #218 -S/F	1.84
S. Main St School	12/9/2017	12/19/2017	701S-26	Outside Rm #203 Lft -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-28	Room #203 -S/F	2.20
S. Main St School	12/9/2017	12/19/2017	701S-29	Room #205 -S/F	1.62
S. Main St School	12/9/2017	12/19/2017	701S-30	Room #206 -S/F	3.84
S. Main St School	12/9/2017	12/19/2017	701S-31	Room #210 -S/F	3.8
S. Main St School	12/9/2017	12/19/2017	701S-32	Room #207 -S/F	3.11
S. Main St School	12/9/2017	12/19/2017	701S-33	Room #209 -S/F	2.04
S. Main St School	12/9/2017	12/19/2017	701S-35	Library Office -S	7.08
S. Main St School	12/9/2017	12/19/2017	701S-36	Outside Rm #203 Rgt -WC	<1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-1	Kitchen Prep -S	8.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-2	Kitchen Prep -S	8.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-3	Kitchen Prep -IM	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-4	Café #1 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-5	Café #2 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-6	Café #3 -WC	ND

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Pleasantville Middle S	12/10/2017	12/20/2017	801-7	Café #4 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-8	Outside Café Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-9	Outside Café Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-10	Room E112 Lft -WC	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-11	Room E112 Rgt -WC	3.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-12	Room E113 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-13	Room E113 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-14	Gym By Mens PE Office Lft-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-15	Gym By Mens PE Office Rgt-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-16	Gym By Girls Locker Rm Lft-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-17	Gym By Girls Locker Rm Rgt-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-18	Gym By Girls Locker Rm -WB	1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-19	Gym Aux Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-20	Gym Aux Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-21	Gym Aux Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-22	Gym Aux Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-23	Outside Rm A103 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-24	Outside Rm A103 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-25	Room A104 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-26	Library B104 -WF	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-27	Room B102C -S	15.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-28	Nurse Office -WF	1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-29	Nurse Office -NS	10.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-30	Room C121 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-31	Outside Rm C103 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-32	Outside Rm C103 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-33	Outside Rm C203 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-34	Outside Rm C203 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-35	Room C205A -S	17.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-36	Outside Rm A203 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-37	Outside Rm A203 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-38	Outside Rm A314 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-39	Outside Rm A314 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-40	Room B303 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-41	Outside Rm C303 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-42	Outside Rm C303 Lft -WC	ND

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Pleasantville Middle S	12/10/2017	12/20/2017	801-43	Gym By Mens PE Office -WB	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-44	Outside Gym Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-45	Outside Gym Lft -WC	ND
Pleasantville High Sci	12/10/2017	12/18/2017	701-1	Main Lobby -Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-2	Main Lobby -Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-3	Main Lobby Kitchen -S	2.07
Pleasantville High Sci	12/10/2017	12/18/2017	701-4	Nurse Office -NS	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-5	Nurse Office -WF	9.84
Pleasantville High Sci	12/10/2017	12/18/2017	701-6	Nurse Office Exam Rm A-NS	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-7	Nurse Office Col Rm -NS	1.34
Pleasantville High Sci	12/10/2017	12/18/2017	701-8	Room C106 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-9	Room C102 -S	3.42
Pleasantville High Sci	12/10/2017	12/18/2017	701-10	Outside Rm C104 Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-11	Outside Rm C104 Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-12	Room C104 -S	10.20
Pleasantville High Sci	12/10/2017	12/18/2017	701-13	Room B113 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-14	Outside B111 Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-15	Outside B111 Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-16	Room B106 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-17	Room B105 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-18	Room A104 -S	15.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-19	Outside Rm A103 Lft -WC	19.40
Pleasantville High Sci	12/10/2017	12/18/2017	701-20	Outside Rm A103 Rg t -WC	54.60
Pleasantville High Sci	12/10/2017	12/18/2017	701-21	Room A103 -S	1.33
Pleasantville High Sci	12/10/2017	12/18/2017	701-22	Room A107 S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-23	Room A106 Lft -S	3.05
Pleasantville High Sci	12/10/2017	12/18/2017	701-24	Room A106 Rgt -S	13.80
Pleasantville High Sci	12/10/2017	12/18/2017	701-26	Outside Caf� Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-27	Outside Caf� Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-28	Kitchen -S	1.88
Pleasantville High Sci	12/10/2017	12/18/2017	701-29	Kitchen Prep 1 -S	7.77
Pleasantville High Sci	12/10/2017	12/18/2017	701-30	Kitchen Prep 2 -S	2.54
Pleasantville High Sci	12/10/2017	12/18/2017	701-31	Kitchen 1 -SK	4.60
Pleasantville High Sci	12/10/2017	12/18/2017	701-32	Kitchen 2 -SK	8.90
Pleasantville High Sci	12/10/2017	12/18/2017	701-33	Pool -WF	<1.00

Appendix D Floor Plan(s)


Deerfield Avenue School

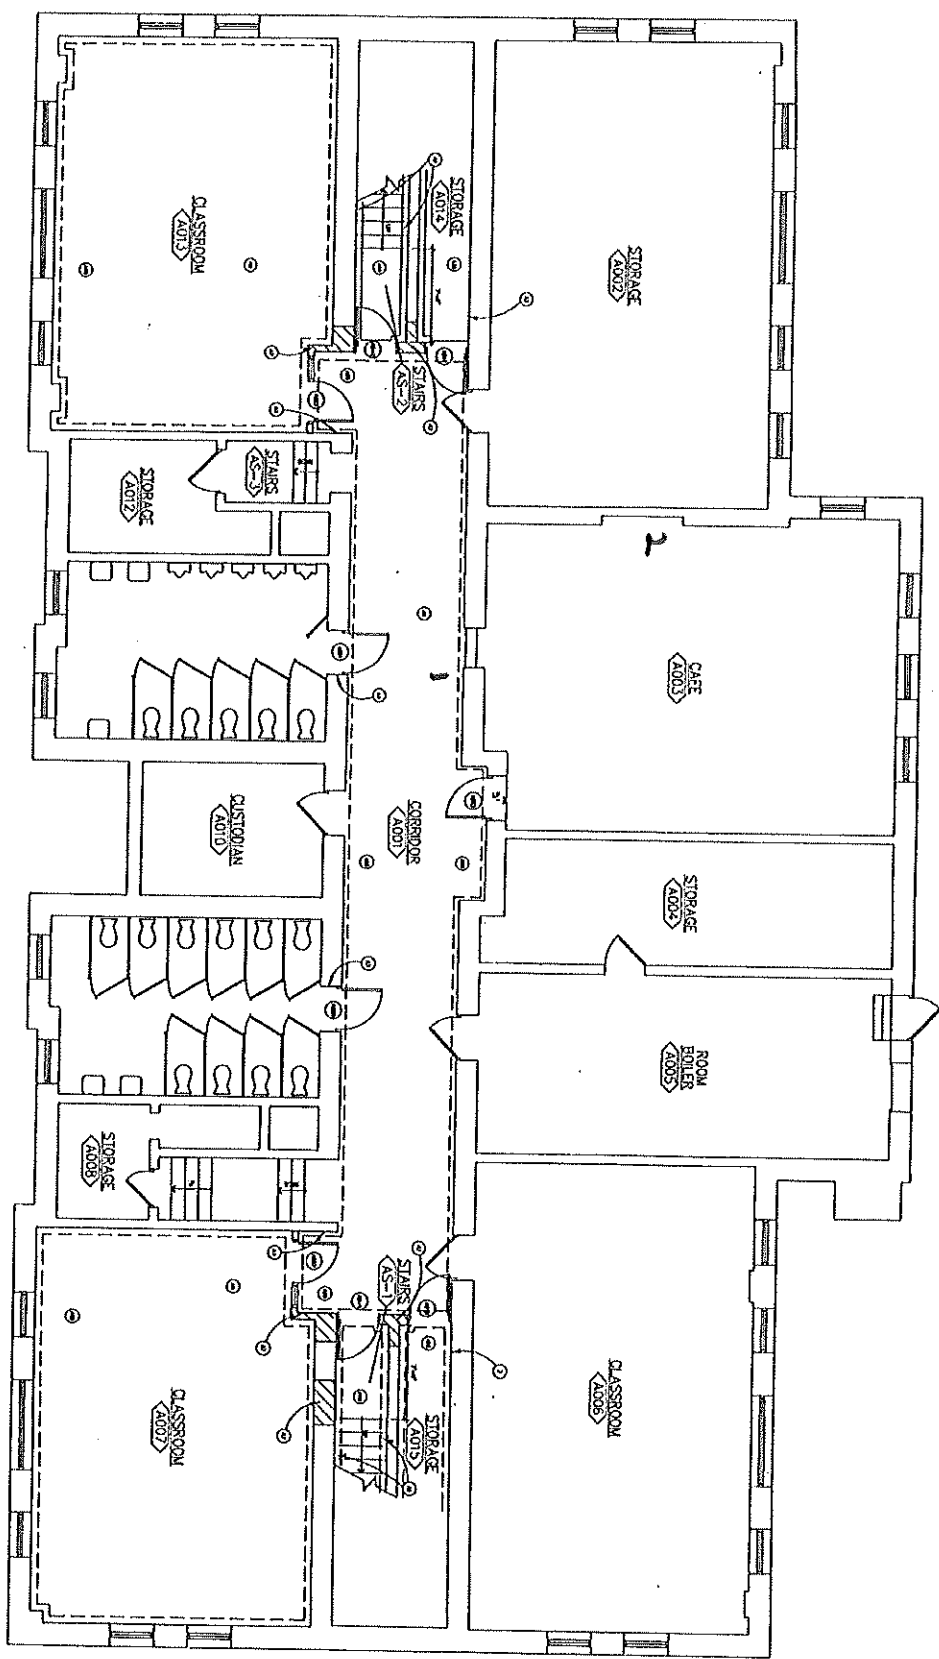

BASMENT FLOOR PLAN
SCALE 1/8" = 1'-0"

- ① CLASSROOM
- ② CLASSROOM
- ③ CLASSROOM
- ④ CLASSROOM
- ⑤ CLASSROOM
- ⑥ CLASSROOM
- ⑦ CLASSROOM
- ⑧ CLASSROOM
- ⑨ CLASSROOM
- ⑩ CLASSROOM
- ⑪ CLASSROOM
- ⑫ CLASSROOM
- ⑬ CLASSROOM
- ⑭ CLASSROOM
- ⑮ CLASSROOM
- ⑯ CLASSROOM
- ⑰ CLASSROOM
- ⑱ CLASSROOM
- ⑲ CLASSROOM
- ⑳ CLASSROOM
- ㉑ CLASSROOM
- ㉒ CLASSROOM
- ㉓ CLASSROOM
- ㉔ CLASSROOM
- ㉕ CLASSROOM
- ㉖ CLASSROOM
- ㉗ CLASSROOM
- ㉘ CLASSROOM
- ㉙ CLASSROOM
- ㉚ CLASSROOM
- ㉛ CLASSROOM
- ㉜ CLASSROOM
- ㉝ CLASSROOM
- ㉞ CLASSROOM
- ㉟ CLASSROOM
- ㊱ CLASSROOM
- ㊲ CLASSROOM
- ㊳ CLASSROOM
- ㊴ CLASSROOM
- ㊵ CLASSROOM
- ㊶ CLASSROOM
- ㊷ CLASSROOM
- ㊸ CLASSROOM
- ㊹ CLASSROOM
- ㊺ CLASSROOM
- ㊻ CLASSROOM
- ㊼ CLASSROOM
- ㊽ CLASSROOM
- ㊾ CLASSROOM
- ㊿ CLASSROOM


Dickson Avenue School

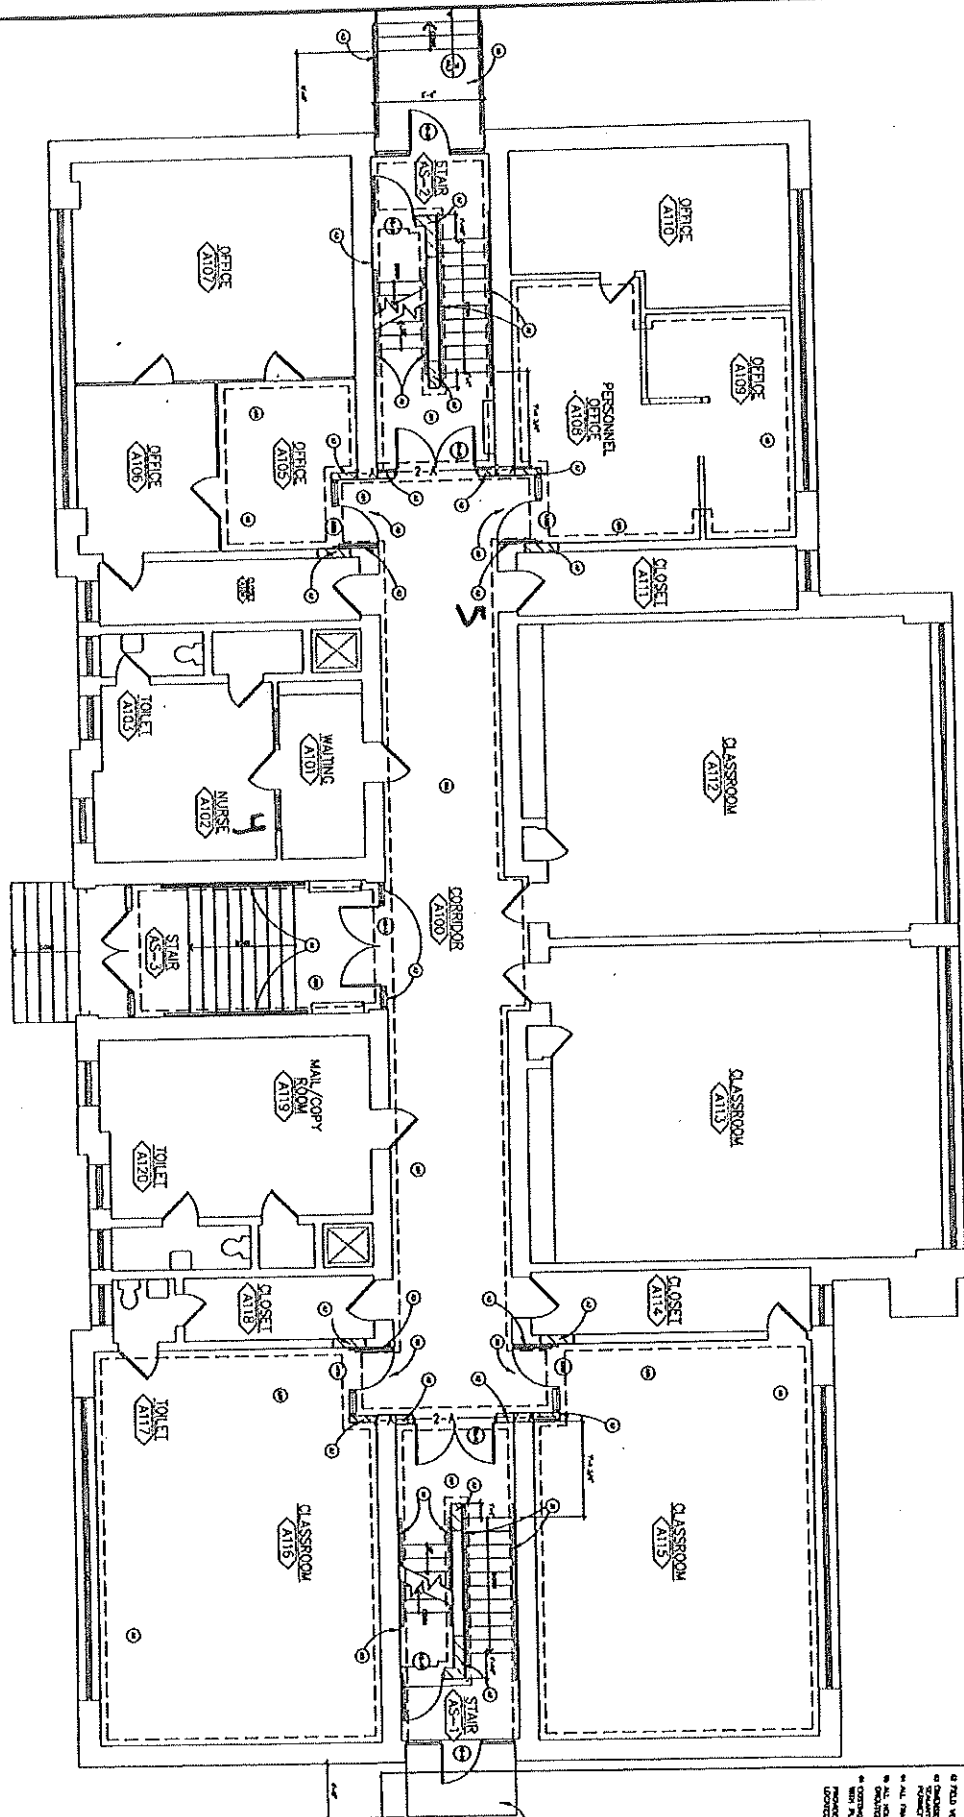

FIRST FLOOR PLAN
Scale: 1/8" = 1'-0"

- 1. ROOM NO.
- 2. ROOM NAME
- 3. ROOM AREA
- 4. ROOM VOLUME
- 5. ROOM PERIMETER
- 6. ROOM HEIGHT
- 7. ROOM FINISH
- 8. ROOM COLOR
- 9. ROOM LIGHTING
- 10. ROOM HEATING
- 11. ROOM COOLING
- 12. ROOM EQUIPMENT
- 13. ROOM FURNITURE
- 14. ROOM NOTES
- 15. ROOM COMMENTS
- 16. ROOM STATUS
- 17. ROOM DATE
- 18. ROOM DRAWN
- 19. ROOM CHECKED
- 20. ROOM APPROVED


DeCatur Avenue School

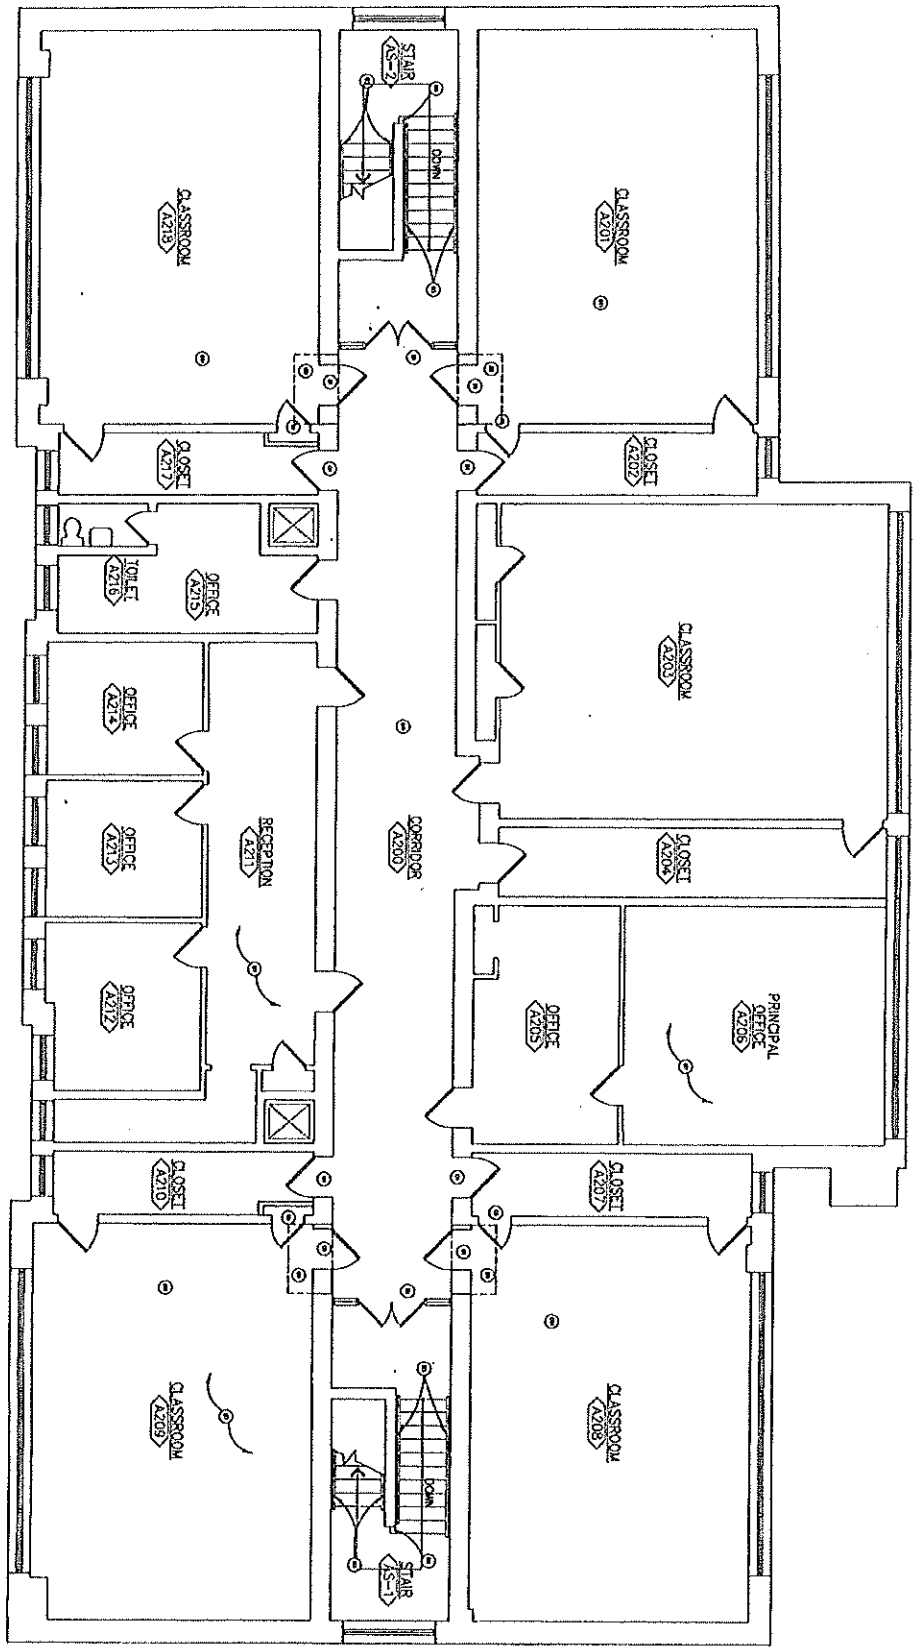


SECOND FLOOR DEMOLITION PLAN

- ① EXISTING
- ② TO BE DEMOLISHED
- ③ TO BE RELOCATED
- ④ TO BE ADDED
- ⑤ TO BE REMOVED
- ⑥ TO BE RECONSTRUCTED
- ⑦ TO BE REFINISHED
- ⑧ TO BE REPAIRED
- ⑨ TO BE REWORKED
- ⑩ TO BE REFINISHED
- ⑪ TO BE REPAIRED
- ⑫ TO BE REWORKED
- ⑬ TO BE REFINISHED
- ⑭ TO BE REPAIRED
- ⑮ TO BE REWORKED
- ⑯ TO BE REFINISHED
- ⑰ TO BE REPAIRED
- ⑱ TO BE REWORKED
- ⑲ TO BE REFINISHED
- ⑳ TO BE REPAIRED
- ㉑ TO BE REWORKED
- ㉒ TO BE REFINISHED
- ㉓ TO BE REPAIRED
- ㉔ TO BE REWORKED
- ㉕ TO BE REFINISHED
- ㉖ TO BE REPAIRED
- ㉗ TO BE REWORKED
- ㉘ TO BE REFINISHED
- ㉙ TO BE REPAIRED
- ㉚ TO BE REWORKED
- ㉛ TO BE REFINISHED
- ㉜ TO BE REPAIRED
- ㉝ TO BE REWORKED
- ㉞ TO BE REFINISHED
- ㉟ TO BE REPAIRED
- ㊱ TO BE REWORKED
- ㊲ TO BE REFINISHED
- ㊳ TO BE REPAIRED
- ㊴ TO BE REWORKED
- ㊵ TO BE REFINISHED
- ㊶ TO BE REPAIRED
- ㊷ TO BE REWORKED
- ㊸ TO BE REFINISHED
- ㊹ TO BE REPAIRED
- ㊺ TO BE REWORKED
- ㊻ TO BE REFINISHED
- ㊼ TO BE REPAIRED
- ㊽ TO BE REWORKED
- ㊾ TO BE REFINISHED
- ㊿ TO BE REPAIRED




FIRST FLOOR PLAN

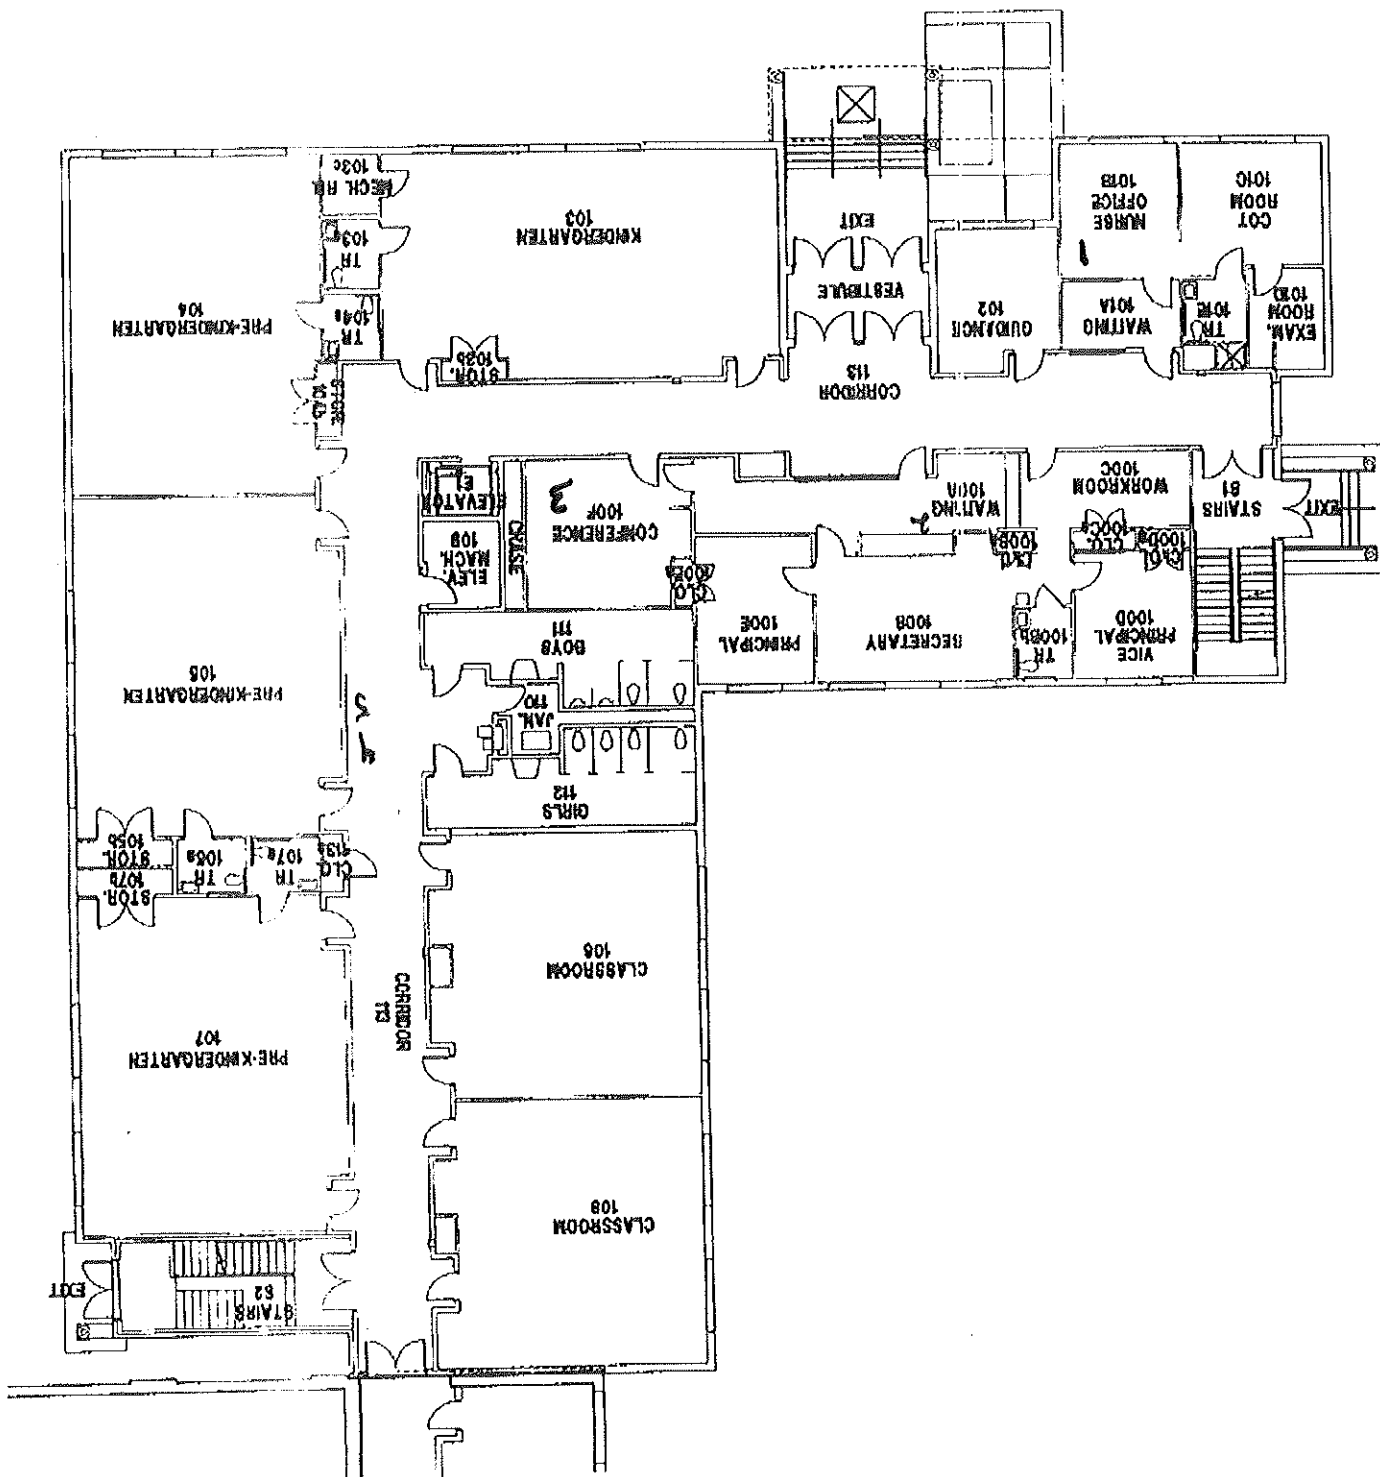



SECOND FLOOR PLAN

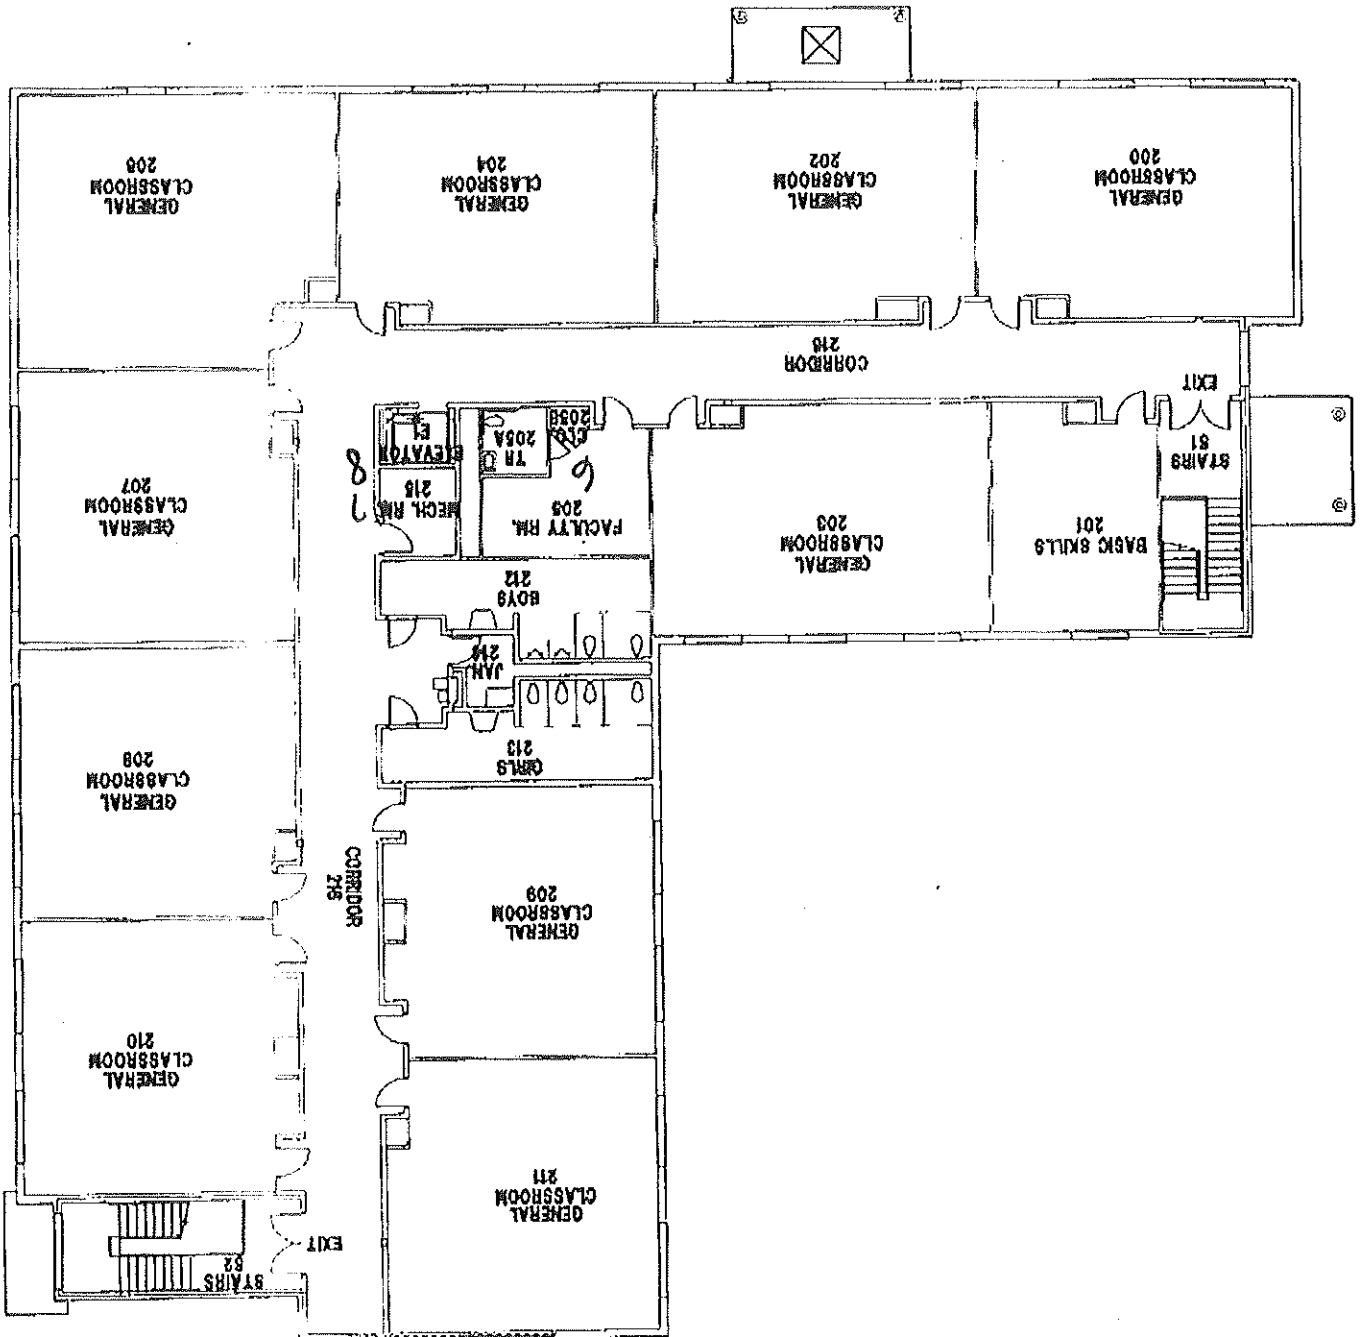


Leads Avenue School
 Pleasantville, New Jersey

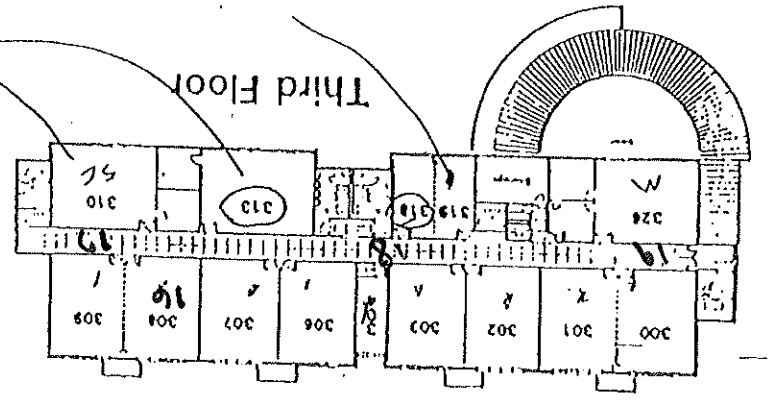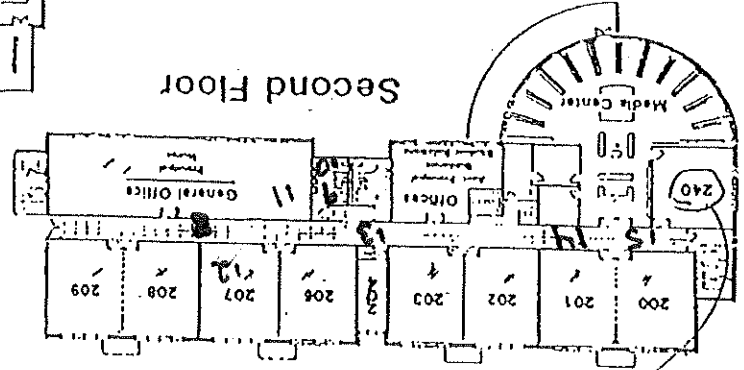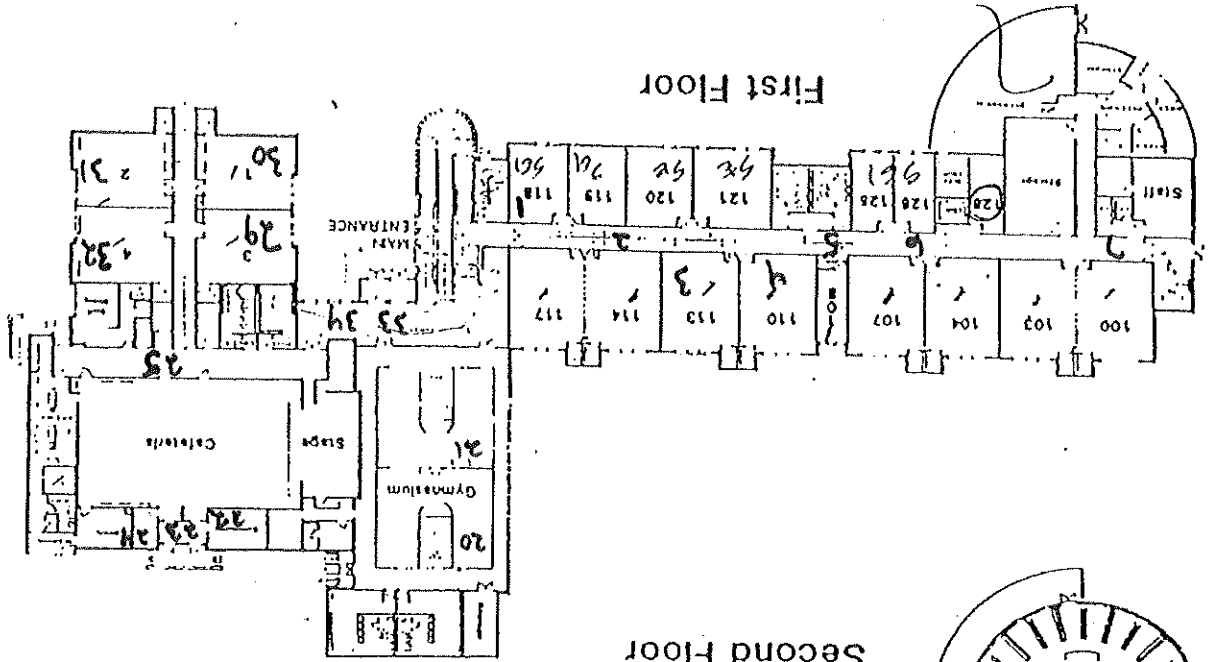

05/23/2005 11:54 6095690182 6095690182

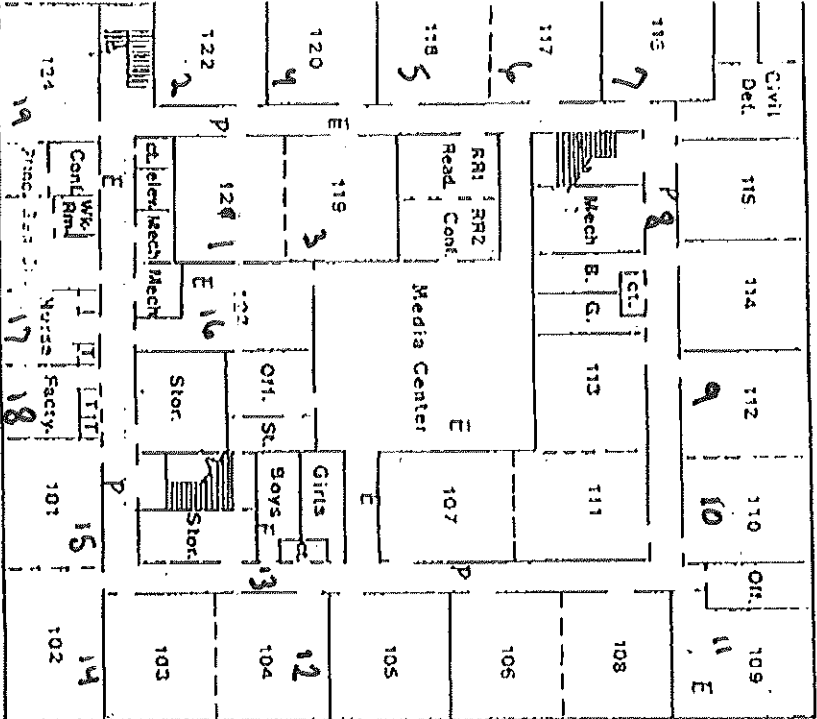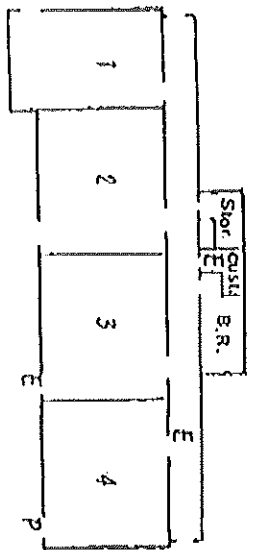

RELOCATABLE

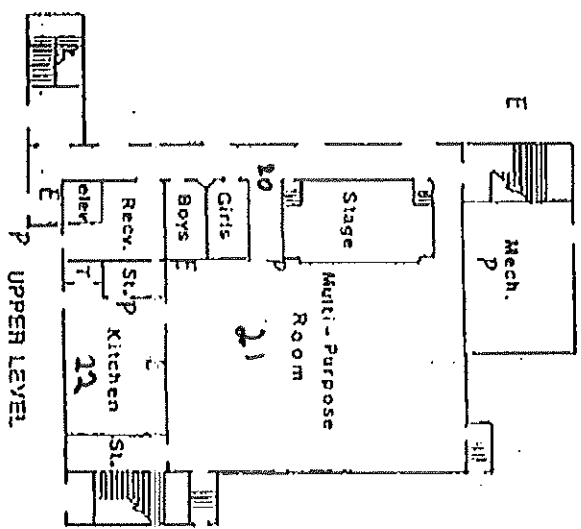


North Main Street School

P = Pull Station
E = Extinguisher

ADD TO MAP
162


1ST / PLR

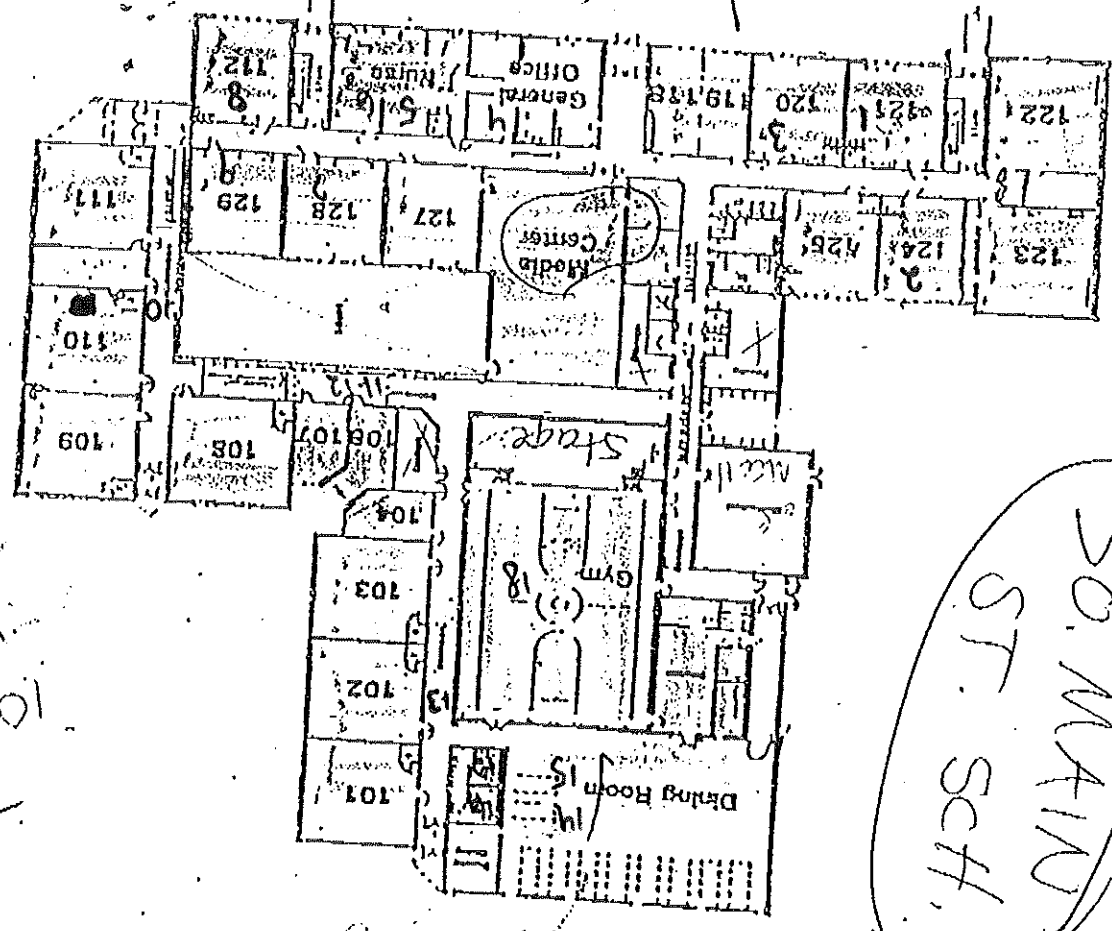


S.O. MAIN
ST. SCH.

1000
→


Second Floor

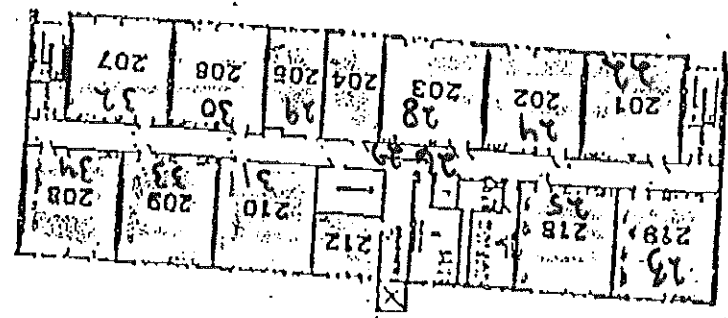

Pleasantville, New Jersey

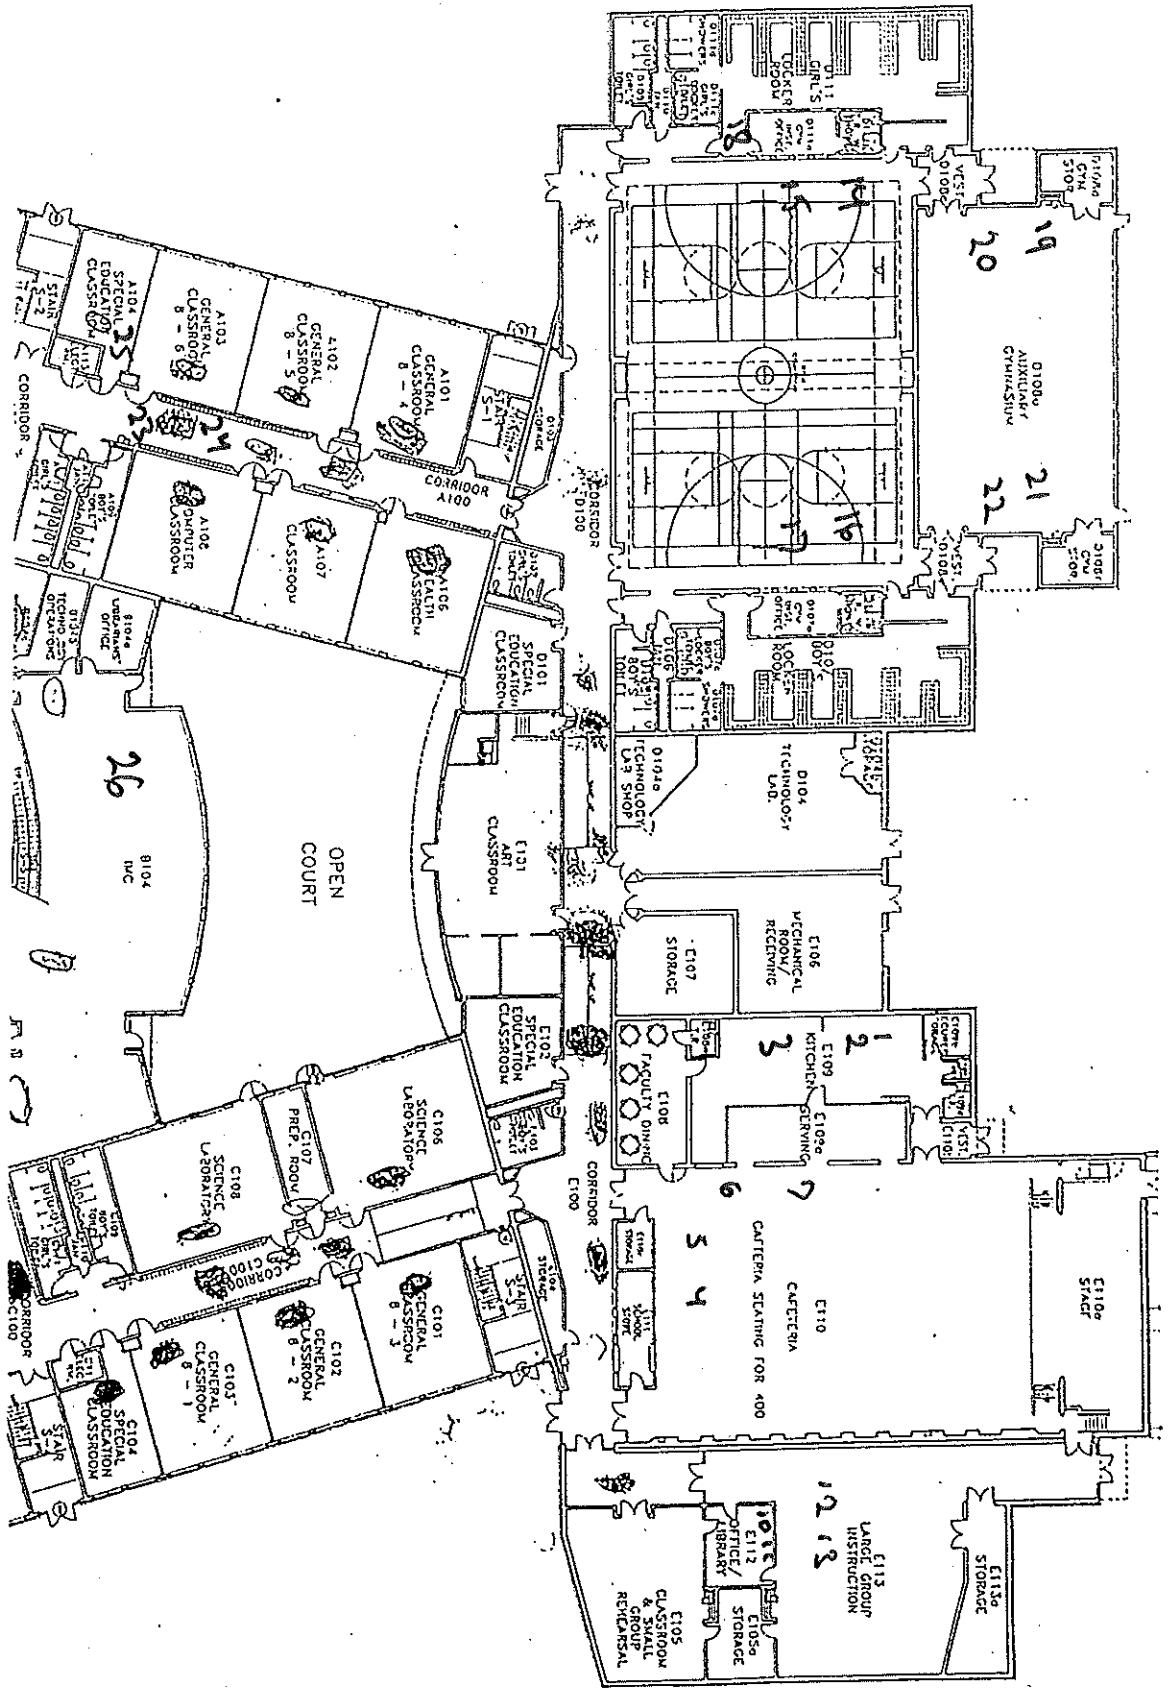

1.1 FIRST FLOOR PLAN
 1.1.1 SCHEMATIC RESUBMISSION - GRADES 5 - 8

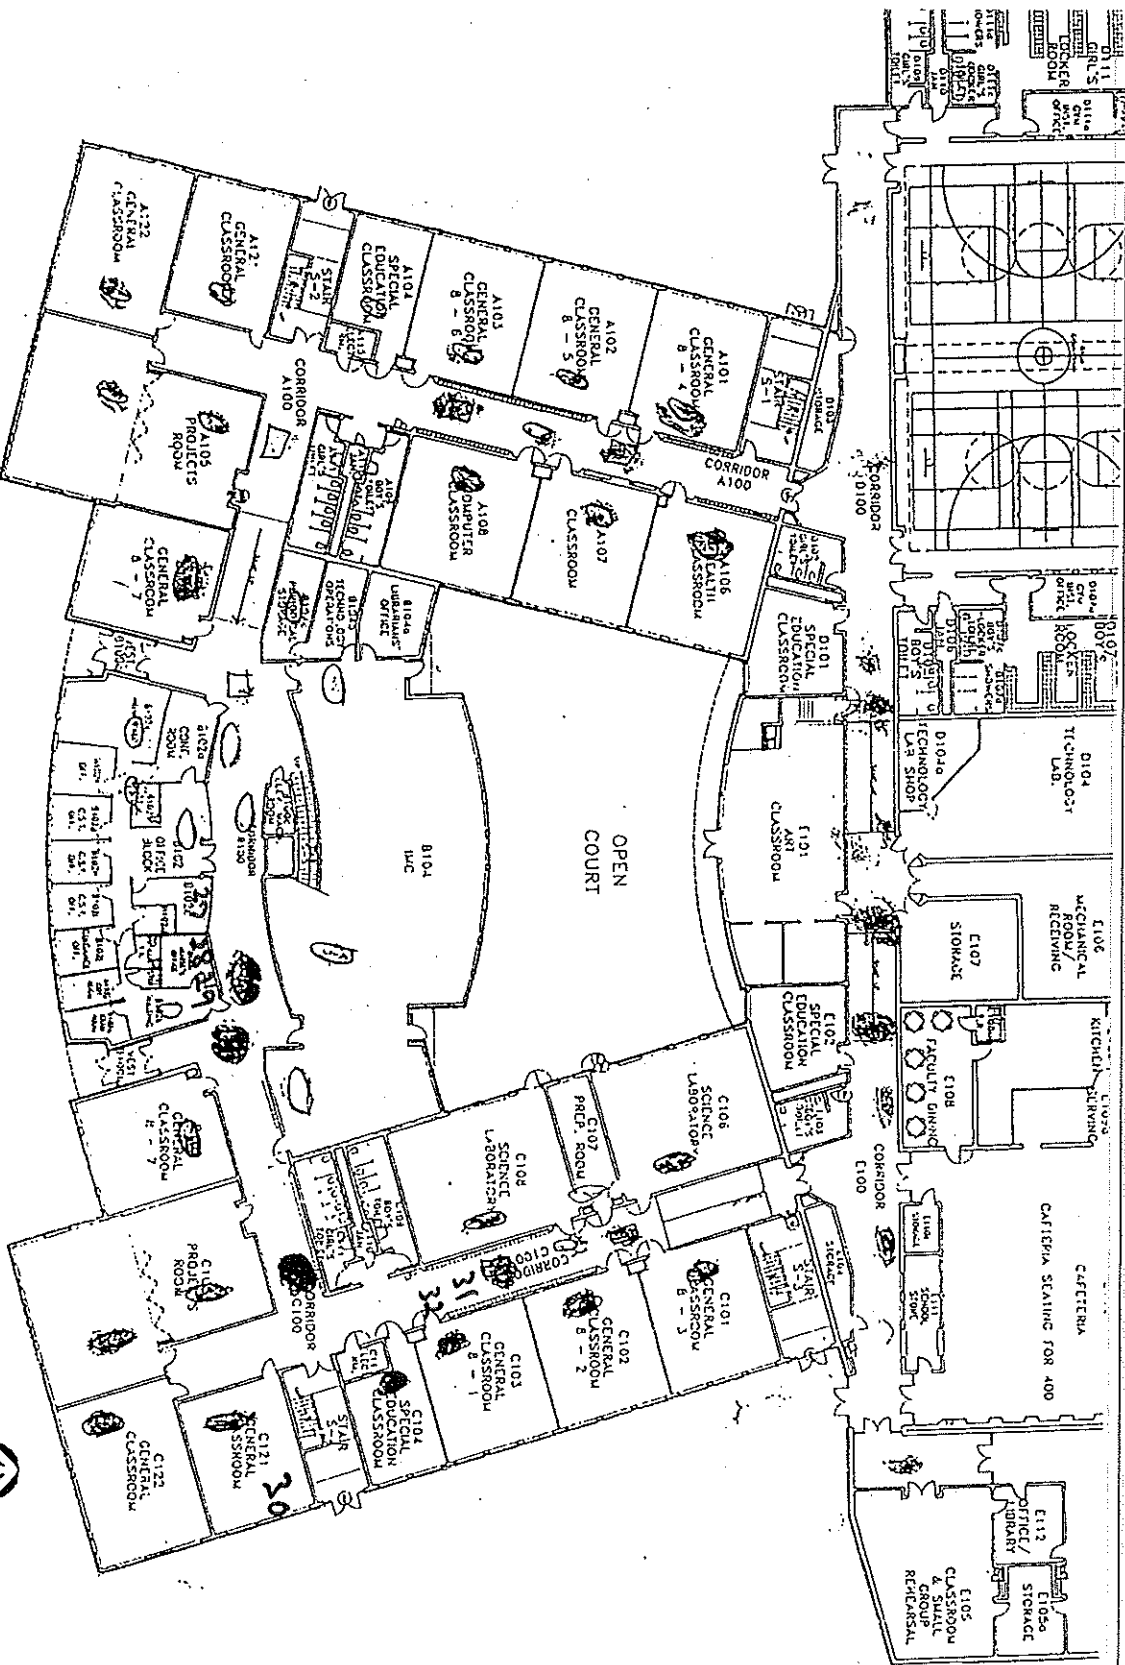

FINAL SUBMISSION - STATE PLAN NUMBER 85288

FORMAL TO PRELIMINARY
PLEASANTVILLE MIDDLE SCHOOL
 PLEASANTVILLE BOARD OF EDUCATION



ATLANTIC COUNTY, NJ

SCHEMATIC RESUBMISSION
 FIRST FLOOR PLAN, GRADES 5-8



PROJECT NORTH


2nd Floor

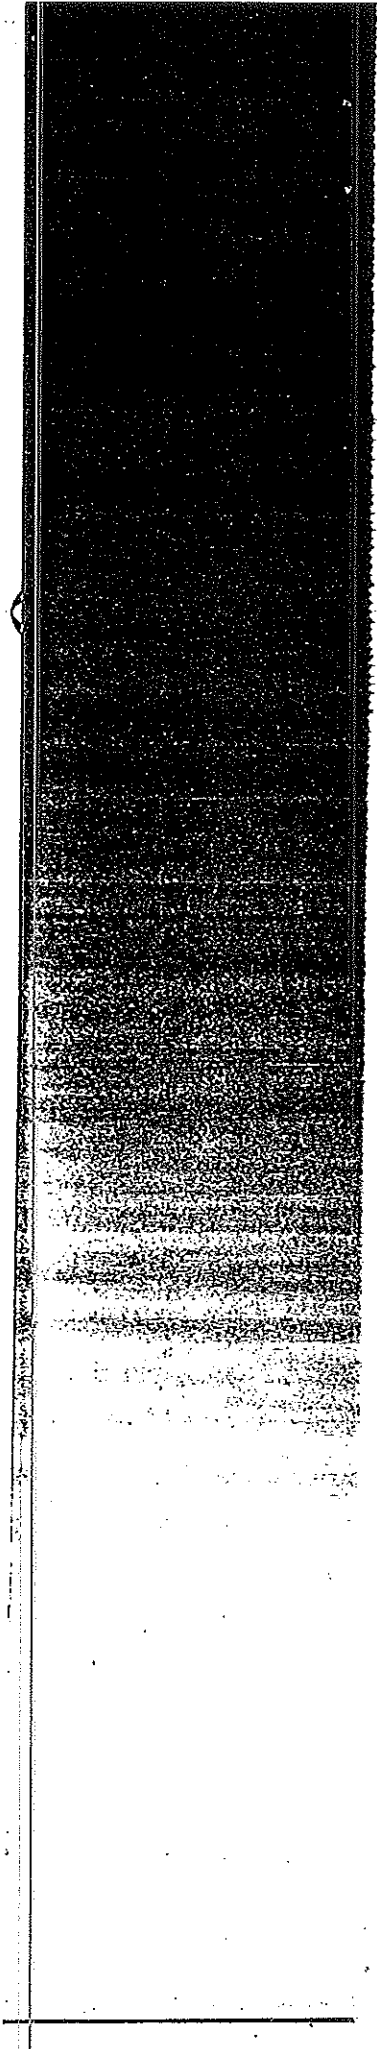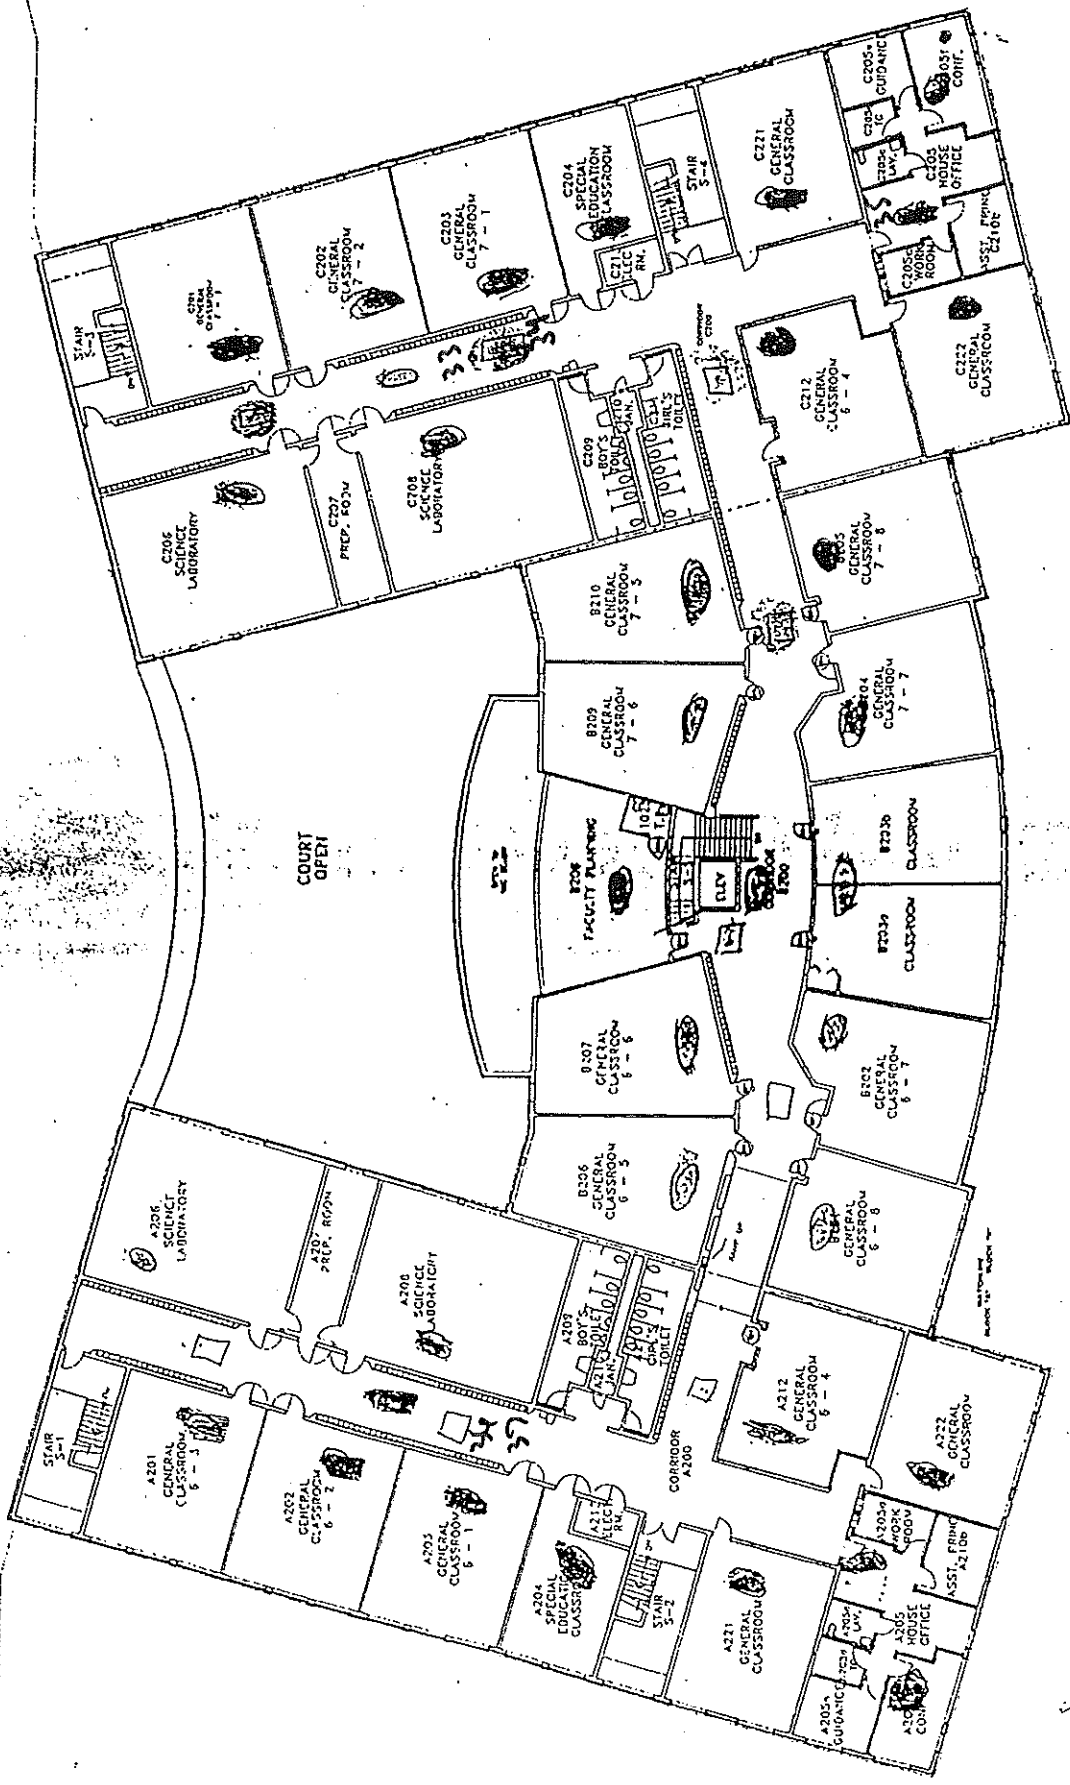



PLEASANTVILLE HIGH SCHOOL

Parking Lot Area

(Form line on the nearest parking lot)



Travel to Parking Lot Area

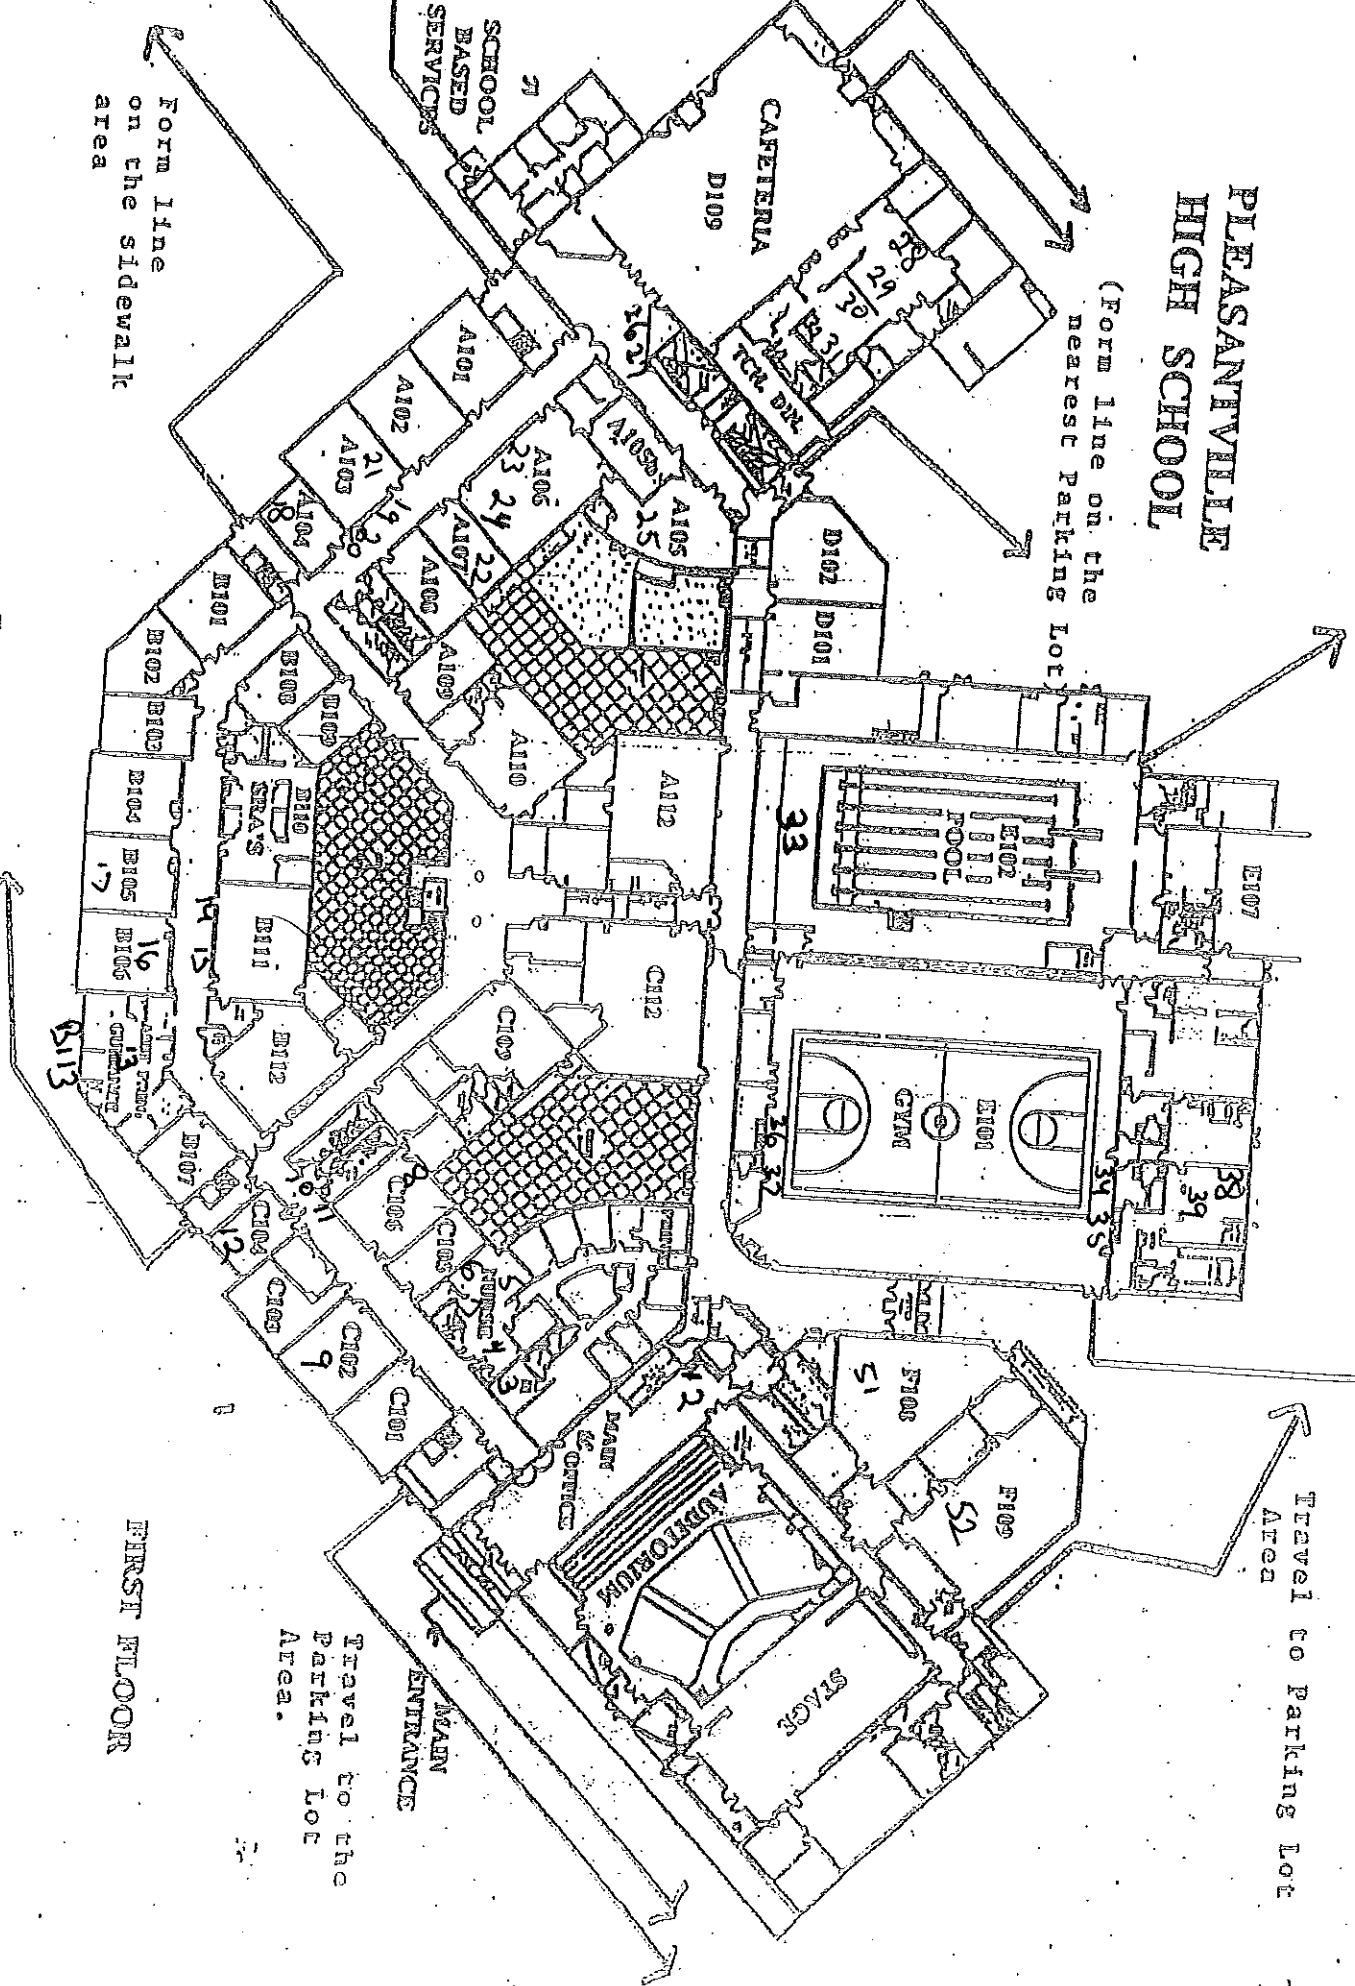

Form line on the sidewalk area

Travel to the sidewalk area, near the fence

FIRST FLOOR

Travel to the parking lot area.

MAIN ENTRANCE

ADMINISTRATIVE

STAGE

GYM

POOL


CAFETERIA

SCHOOL BASED SERVICES

POOL

GYM

PLEASANTVILLE
HIGH SCHOOL

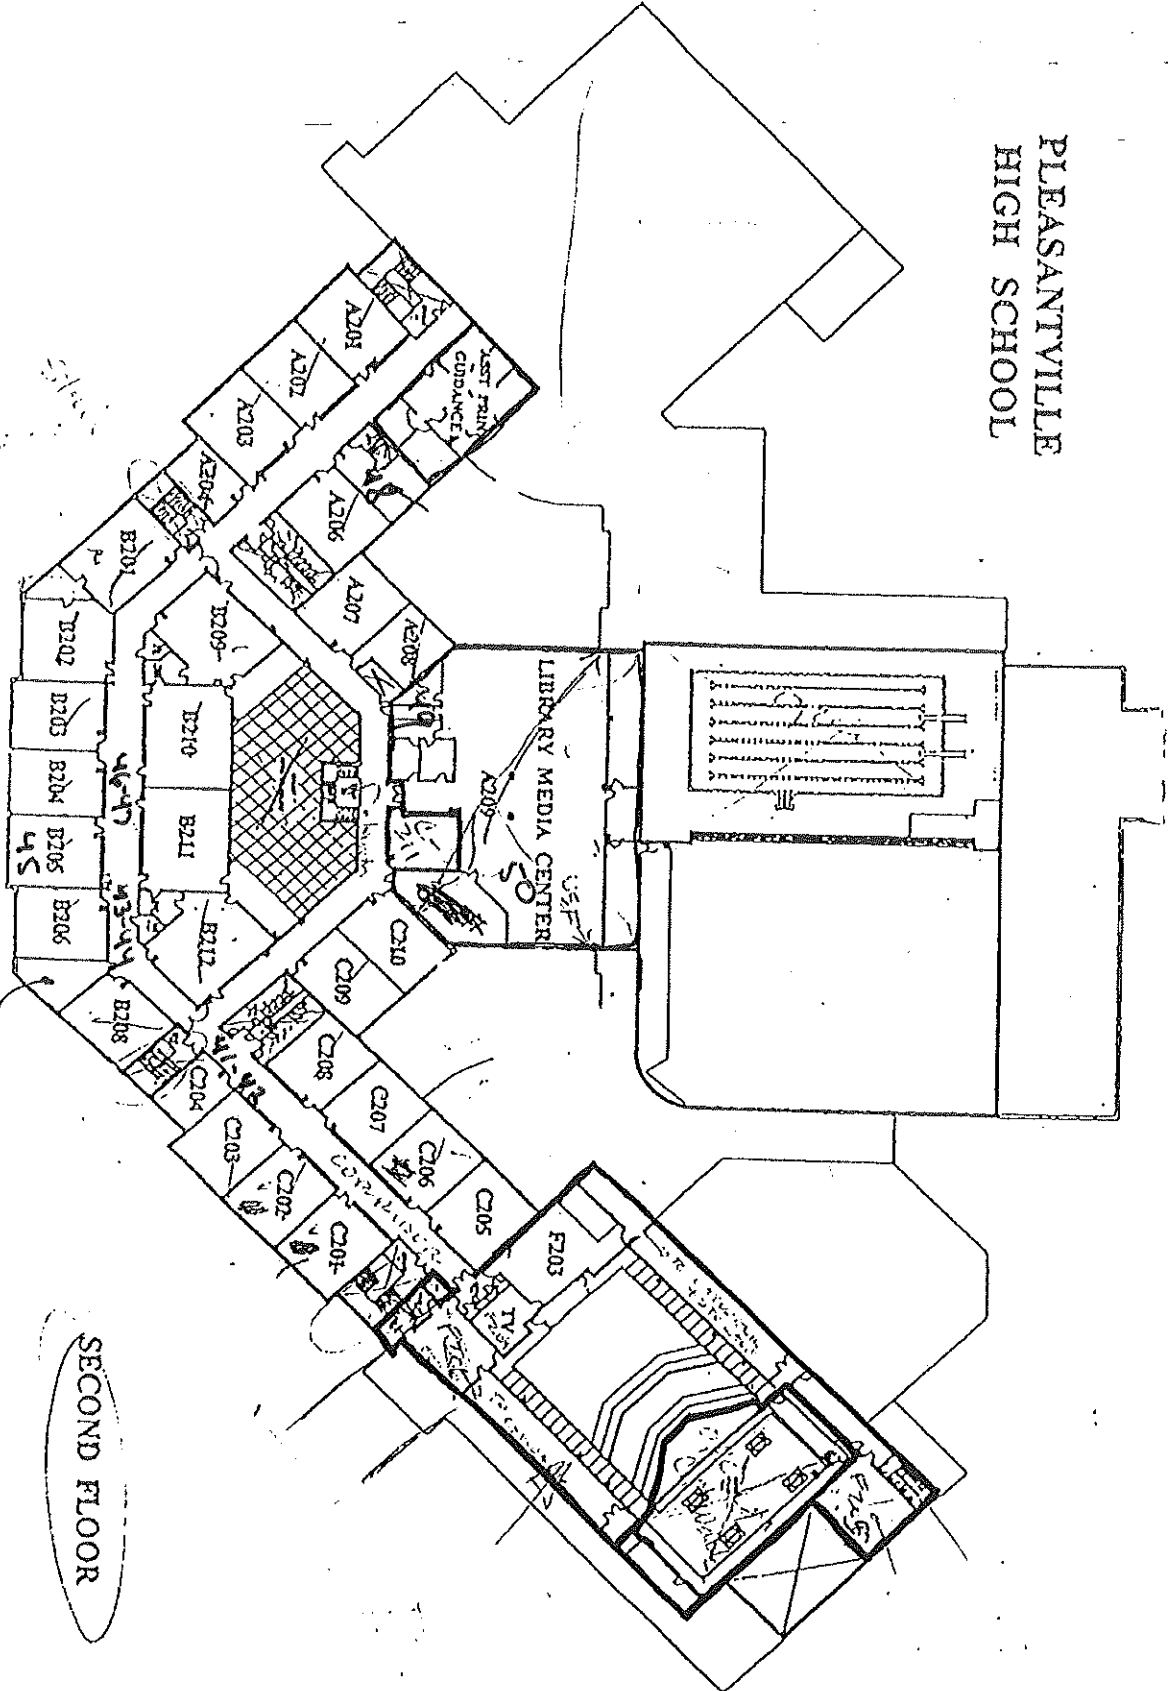

SECOND FLOOR

Appendix E Laboratory Data



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 20, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; 225 Washington Ave.; Washington Ave. School; Pleasantville, NJ 08232

Report Number: 17-12-02425

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Report Number: 17-12-02425
 Received Date: 12/15/2017
 Reported Date: 12/20/2017
 Sampled By: Raheen Holland
 Tech Certification #:

Project/Test Address: 171324; 225 Washington Ave.; Washington Ave. School; Pleasantville, NJ
 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02425-001	225-2	12/09/2017	MAIN OFFICE WC	<1.00	12/19/2017	
17-12-02425-002	225-4	12/09/2017	OUTSIDE RM 105B LFT WC	<1.00	12/19/2017	
17-12-02425-003	225-5	12/09/2017	OUTSIDE RM 105B RGT WC	<1.00	12/19/2017	
17-12-02425-004	225-6	12/09/2017	FACULTY ROOM S	4.79	12/19/2017	
17-12-02425-005	225-7	12/09/2017	OUTSIDE ELECTRIC RM LFT WC	<1.00	12/19/2017	
17-12-02425-006	225-8	12/09/2017	OUTSIDE ELECTRIC RM RGT WC	<1.00	12/19/2017	
17-12-02425-007	225-9	12/09/2017	GYM WC	<1.00	12/19/2017	
17-12-02425-008	225-10	12/09/2017	CAFE LFT WC	<1.00	12/19/2017	
17-12-02425-009	225-11	12/09/2017	CAFE RGT WC	<1.00	12/19/2017	
17-12-02425-010	225-12	12/09/2017	KITCHEN PREP S	15.9	12/19/2017	
17-12-02425-011	225-13	12/09/2017	KITCHEN SK	229	12/19/2017	
17-12-02425-012	225-14	12/09/2017	OUTSIDE ART RM LFT WC	<1.00	12/19/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02425

Project/Test Address: 171324; 225 Washington Ave.; Washington Ave. School;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02425-013	225-15	12/09/2017	OUTSIDE ART RM RGT WC	<1.00	12/19/2017	
17-12-02425-014	225	12/09/2017	LOT 2706B10	<1.00	12/19/2017	

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

17-12-02425



Due Date:
12/22/2017
(Friday)
AE



Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324 p25 Washington Ave School

City/State/Zip: Pleasantville, NJ 08322

P.O. #: _____

Sampled By: Rabeen Holland

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE Temp at Time of Receipt:
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
<div style="display: flex; justify-content: space-between;"> 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead </div>										
1	225-2	Main Office	12-9-19	12	AM					
2	4	Outside Rm 105 R			AM					
3	5	Outside Rm 105 R			AM					
4	6	Faculty Room			AM					
5	7	Outside Rm 105 R			AM					
6	8	Outside Electric Rm			AM					
7	9	Gym			AM					
8	10	Cafe - LFT			AM					
9	11	Cafe - Rpt			AM					
10	12	Kitchen Prep			AM					
Released by: Rabeen Holland Signature:										
Released by: STONE Signature:										
Date/Time: 12-11-19 11:24am Date/Time: 12/15/19 2:23pm										



EHS Laboratories
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
 SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

2425

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324 / 225 Washington Ave

City/State/Zip: Pleasantville, NJ 08852

P.O. #: _____

Sampled By: Raheem Holland

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

<input checked="" type="checkbox"/>	5 Day Turnaround	<input type="checkbox"/>	3 Day Turnaround	<input type="checkbox"/>	2 Day Turnaround	<input type="checkbox"/>	1 Day Turnaround * Call Ahead
-------------------------------------	------------------	--------------------------	------------------	--------------------------	------------------	--------------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	225-13	Kitchen	12-9-17	12	<input checked="" type="checkbox"/>					
2	-14	Outside A.D.Rm			<input checked="" type="checkbox"/>					
3	-15	Outside A.D.Rm			<input checked="" type="checkbox"/>					
4	-	Outside A.D.Rm			<input checked="" type="checkbox"/>					
5										
6										
7										
8										
9										
10										

Released by: Raheem Holland
 Signature: [Signature]
 Date/Time: 12-11-17 11:24

Released by: [Signature]
 Signature: [Signature]
 Date/Time: 12/15/17 2:23pm



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 20, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; 701 S. Main St.; S. Main St. School; Pleasantville, NJ 08232

Report Number: 17-12-02416

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read "Howard Varner". The signature is fluid and cursive, with the first name "Howard" and last name "Varner" clearly distinguishable.

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Report Number: 17-12-02416
 Received Date: 12/15/2017
 Reported Date: 12/20/2017
 Sampled By: Raheen Holland
 Tech Certification #:

Project/Test Address: 171324; 701 S. Main St.; S. Main St. School; Pleasantville, NJ 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02416-001	701S-1	12/09/2017	ROOM 121 S/F	5.55	12/19/2017	
17-12-02416-002	701S-2	12/09/2017	ROOM 124 S/F	2.47	12/19/2017	
17-12-02416-003	701S-3	12/09/2017	ROOM 120 S/F	5.59	12/19/2017	
17-12-02416-004	701S-4	12/09/2017	MAIN OFFICE WC	<1.00	12/19/2017	
17-12-02416-005	701S-5	12/09/2017	NURSE OFFICE NS	4.04	12/19/2017	
17-12-02416-006	701S-6	12/09/2017	NURSE OFFICE NS	2.96	12/19/2017	
17-12-02416-007	701S-7	12/09/2017	ROOM 128 S/F	2.21	12/19/2017	
17-12-02416-008	701S-9	12/09/2017	ROOM 129 S/F	13.9	12/19/2017	
17-12-02416-009	701S-10	12/09/2017	OUTSIDE ROOM 110 WC	<1.00	12/19/2017	
17-12-02416-010	701S-11	12/09/2017	OUTSIDE ROOM 106 LFT WC	<1.00	12/19/2017	
17-12-02416-011	701S-12	12/09/2017	OUTSIDE RM 106 RGT WC	<1.00	12/19/2017	
17-12-02416-012	701S-13	12/09/2017	OUTSIDE RM 102 WC	<1.00	12/19/2017	
17-12-02416-013	701S-14	12/09/2017	CAFE LFT WC	1.01	12/19/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02416

Project/Test Address: 171324; 701 S. Main St.; S. Main St. School;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02416-014	701S-15	12/09/2017	CAFE RGT WC	1.04	12/19/2017	
17-12-02416-015	701S-16	12/09/2017	KITCHEN S	5.14	12/19/2017	
17-12-02416-016	701S-17	12/09/2017	KITCHEN SK	4.16	12/19/2017	
17-12-02416-017	701S-18	12/09/2017	GYM WC	5.21	12/19/2017	
17-12-02416-018	701S-19	12/09/2017	OUTSIDE FACULTY LOUNGE LFT WC	<1.00	12/19/2017	
17-12-02416-019	701S-20	12/09/2017	OUTSIDE FACULTY LOUNGE RGT WC	<1.00	12/19/2017	
17-12-02416-020	701S-21	12/09/2017	FACULTY LOUNGE S	4.21	12/19/2017	
17-12-02416-021	701S-22	12/09/2017	ROOM 201 S/F	6.98	12/19/2017	
17-12-02416-022	701S-24	12/09/2017	ROOM 202 S/F	3.00	12/19/2017	
17-12-02416-023	701S-25	12/09/2017	ROOM 218 S/F	1.84	12/19/2017	
17-12-02416-024	701S-26	12/09/2017	OUTSIDE RM 203 LFT WC	<1.00	12/19/2017	
17-12-02416-025	701S-28	12/09/2017	ROOM 203 S/F	2.20	12/19/2017	
17-12-02416-026	701S-29	12/09/2017	ROOM 205 S/F	1.62	12/19/2017	
17-12-02416-027	701S-30	12/09/2017	ROOM 206 S/F	3.84	12/19/2017	
17-12-02416-028	701S-31	12/09/2017	ROOM 210 S/F	3.80	12/19/2017	
17-12-02416-029	701S-32	12/09/2017	ROOM 207 S/F	3.11	12/19/2017	
17-12-02416-030	701S-33	12/09/2017	ROOM 209 S/F	2.04	12/19/2017	
17-12-02416-031	701S-35	12/09/2017	LIBRARY OFFICE S	7.08	12/19/2017	
17-12-02416-032	701S-36	12/09/2017	OUTSIDE RM 203 RGT WC	<1.00	12/19/2017	
17-12-02416-033	701S-37	12/09/2017	SUN ROOM S	<1.00	12/19/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02416

Project/Test Address: 171324; 701 S. Main St.; S. Main St. School;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324 / S. Main St School

City/State/Zip: Pleasantville, NJ 08232

P.O. #: _____ Sampled By: Rahreen Holland

License # (if Required): _____

Water Source: (Check One) Public Well Well Tag # (if Applicable): _____

<input checked="" type="checkbox"/> 5 Day Turnaround	<input type="checkbox"/> 3 Day Turnaround	<input type="checkbox"/> 2 Day Turnaround	<input type="checkbox"/> 1 Day Turnaround * Call Ahead
--	---	---	--

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	2019-1	Room # 121-S/F	12-9-17	8 AM/PM	X	-	-	-	-	-
2	-2	Room # 124-S/F		AM/PM						
3	-3	Room # 120-S/F		AM/PM						
4	-4	Main Office		AM/PM						
5	-5	Nurse Office		AM/PM						
6	-6	Nurse Office		AM/PM						
7	-7	Room # 128		AM/PM						
8	-9	Room # 129		AM/PM						
9	-10	Outside Room #110		AM/PM						
10	-11	Outside Room #106		AM/PM						

Released by: Rahreen Holland Signature: _____ Date/Time: 12-11-17 11:53 PM

Released by: STONE Signature: _____ Date/Time: 12/15/17 1:53 pm

17-12-02416

Due Date: 12/22/2017 (Friday) AE



EHS Laboratories

ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW Corporation

Address: 1090 Bristol Road

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

City/State/Zip: Mountainside, NJ 07092

Account #: 201327

~ For Lab Use Only ~

24/6

S. main St School

Pleasantville, NJ 08232

Sampled By: Raheen Holland

License # (if Required):

Water Source: (Check One) Public Well Well Tag # (if Applicable):

<input checked="" type="checkbox"/> X	5 Day Turnaround	<input type="checkbox"/>	3 Day Turnaround	<input type="checkbox"/>	2 Day Turnaround	<input type="checkbox"/>	1 Day Turnaround * Call Ahead
---------------------------------------	------------------	--------------------------	------------------	--------------------------	------------------	--------------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	2013-12	Outside Run #106-Rgt-WC	12-9-12	8:00 AM / PM	X	-	1st New			
2	-13	Outside Run #102-WC		8:00 AM / PM		-				
3	-14	Cafe - LFI		8:00 AM / PM		-				
4	-15	Cafe - Rgt		8:00 AM / PM		-				
5	-16	Kitchen		8:00 AM / PM		-				
6	-17	↓		8:00 AM / PM		-				
7	-18	Gym		8:00 AM / PM		-				
8	-19	Outside Faculty Lounge - WC		8:00 AM / PM		-				
9	-20	Outside Faculty Lounge - WC		8:00 AM / PM		-				
10	-21	Faculty Lounge		8:00 AM / PM		-				

Released by: Raheen Holland Signature: [Signature] Date/Time: 12-11-12 11:52 AM

Released by: Stone Signature: [Signature] Date/Time: 12/15/12 1:53 PM



EHS Laboratories
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
 SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

S. Main St School

Project Name / Collection Address: 171324/201 S. Main St

City/State/Zip: Pleasantville, NJ 08232

P.O. #: _____ Sampled By: Raheem Holland

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals		Field Parameters		LAB USE	
					Lead	Copper	Other	Temp. at Time of Receipt:		
1	2013-22	Room #201	-3/F	12-9-10	8	AM/PM	X	-	1st Drew	
2	-24	#202	-S/F			AM/PM				
3	-25	#218	-S/F			AM/PM				
4	-26	Outside Rm # 203	-S/F			AM/PM				
5	-28	Room #203	-S/F			AM/PM				
6	-29	#205	-			AM/PM				
7	-30	#206	-			AM/PM				
8	-31	#210	-			AM/PM				
9	-32	#207	-			AM/PM				
10	-33	#209	-			AM/PM				

Released by: Raheem Holland Signature: _____ Date/Time: 12-11-10 1:53 PM

Released by: STONER Signature: _____ Date/Time: 12/15/10 1:53 PM

~ For Lab Use Only ~
 2416



EHS Laboratories™
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
 SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW Corporation Account #: 201327
 Address: 1090 Bristol Road City/State/Zip: Mountainside, NJ 07092
 Phone: 908-654-8068 Email: labresults@lewcorp.com Fax: 908-654-8069

2416

Project Name / Collection Address: 171329 / 701 S. Main St City/State/Zip: Pleasantville, NJ 08232
 (Required) (Required)
 P. O. #: _____ Sampled By: Raheem Holland License # (If Required): _____
 Water Source: (Check One) Public Well Well Tag # (If Applicable): _____
 (Required)

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE Temp at Time of Receipt:
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	2015-35	Library Office - S	12-9-12	8 AM PM	X	-	1st Ave			
2	-36	Outside Room #203 - WC		AM/PM		-				
3	-37	Su Room - S		AM/PM		-	Lot # 2706810			
4				AM/PM						
5				AM/PM						
6				AM/PM						
7				AM/PM						
8				AM/PM						
9				AM/PM						
10				AM/PM						

Released by: Raheem Holland Signature: [Signature] Date/Time: 12-11-12 11:54am
 Released by: T Stone Signature: [Signature] Date/Time: 12/15/12 1:52pm

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead



556 South Mansfield Street
Ypsilanti, MI 48197
1-800-604-1995

WaterSmart Custom

Analysis Report

Customer: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 17-12-02934
Received Date: 12/15/2017
Reported Date: 12/22/2017
Sampled By: Raheen Holland
Tech Certification #:

P.O. Number:

Project Test/Address: 171324/ Pleasantville Middle School; 801 Mill Rd., Pleasantville, NJ 08232

Client Number: 201327

Report Notes

Sample #	Sample ID	Method	Parameter	Level Detected	EPA Standards	Units	LRL	Date Sampled	Date Analyzed
748668	801-1 Kitchen Prep-S	3113B	Lead	8	15	ug/L	1	12/10/2017	12/20/2017
748669	801-2 Kitchen Prep-S	3113B	Lead	8	15	ug/L	1	12/10/2017	12/20/2017
748670	801-3 Kitchen Pep-IM	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748671	801-4 Cafe #1-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748672	801-5 Cafe #2-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748673	801-6 Cafe #3-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748674	801-7 Cafe #4-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748675	801-8 Outside Cafe-LFT-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748676	801-9 Outside Cafe-RGT-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/20/2017
748677	801-10 Room E112-LFT-WC	3113B	Lead	2	15	ug/L	1	12/10/2017	12/21/2017
748678	801-11 Room E112-RGT-WC	3113B	Lead	3	15	ug/L	1	12/10/2017	12/21/2017
748679	801-12 Room E113-LFT-WC	3113B	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748680	801-13 Room E113-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748681	801-14 Gym by Mens PE Office-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748682	801-15 Gym by Mens PE Office-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017

Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc. were provided by the client. This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, LTD.



556 South Mansfield Street
Ypsilanti, MI 48197
1-800-604-1995

WaterSmart Custom

Analysis Report

Sample #	Sample ID	Method	Parameter	Level Detected	EPA Standards	Units	LRL	Date Sampled	Date Analyzed
748683	801-16 Gym by Girl Locker Rm-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748684	801-17 Gym by Girl Locker Rm-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748685	801-18 Gym by Girl Locker Rm-WB	200.8	Lead	1	15	ug/L	1	12/10/2017	12/21/2017
748686	801-19 Gym Aux-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748687	801-20 Gym Aux-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748688	801-21 Gym Aux-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748689	801-22 Gym Aux-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748690	801-23 Outside Rm A103-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748691	801-24 Outside Rm A103-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748692	801-25 Room A104-S	200.8	Lead	2	15	ug/L	1	12/10/2017	12/21/2017
748693	801-26 Library-B104-WF	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748694	801-27 Room B102C-S	200.8	Lead	15	15	ug/L	5	12/10/2017	12/21/2017
748695	801-28 Nurse Office-WF	200.8	Lead	1	15	ug/L	1	12/10/2017	12/21/2017
748696	801-29 Nurse Office-NS	200.8	Lead	10	15	ug/L	1	12/10/2017	12/21/2017
748697	801-30 Room C121-S	200.8	Lead	2	15	ug/L	1	12/10/2017	12/21/2017
748698	801-31 Outside Rm C103-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748699	801-32 Outside Rm C103-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748700	801-33 Outside Rm C203-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748701	801-34 Outside Rm C203-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017

Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc. were provided by the client. This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, LTD.



556 South Mansfield Street
Ypsilanti, MI 48197
1-800-604-1995

WaterSmart Custom

Analysis Report

Sample #	Sample ID	Method	Parameter	Level Detected	EPA Standards	Units	LRL	Date Sampled	Date Analyzed
748702	801-35 Room C205A-S	200.8	Lead	17	15	ug/L	1	12/10/2017	12/21/2017
748703	801-36 Outside Rm A203-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/19/2017
748704	801-37 Outside Rm A203-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748705	801-38 Outside Rm A314-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748706	801-39 Outside Rm A314-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748707	801-40 Room B303-S	200.8	Lead	2	15	ug/L	1	12/10/2017	12/21/2017
748708	801-41 Outside Rm C303-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748709	801-42 Outside Rm C303-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748710	801-43 Gym by Mens PE Office-WB	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748711	8010-44 Outside gym-LFT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748712	801-45 Outside Gym-RGT-WC	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017
748713	801-46 Sun Rm-S	200.8	Lead	ND	15	ug/L	1	12/10/2017	12/21/2017

Analyst	Tests
DD	3113B
SMG	200.8

The results herein conform to TNI and ISO/IEC 17025:2005 standards, where applicable, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as Eastern Time.

Legend:

- "ND" This contaminant was not detected at or above our lower reporting limit (LRL).
- "NA" Not analyzed.
- "EPA Standard" This column indicates the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.
- "LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.
- "P/A" Presence/Absence

Reviewed by Authorized Signatory

Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc. were provided by the client. This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, LTD.

Laboratory Certification #: MI859



Quality Water Analysis

556 South Mansfield Street
Ypsilanti, MI 48197
1-800-604-1995

WaterSmart Custom

Analysis Report

Megan Gregg



ENVIRONMENTAL HAZARDOUS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



17-12-02934

2103409

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountlake, NJ 07092

Phone: 908-654-8068

Fax: 908-654-8069

Project Name / Collection Address: Pleasantville Middle School

Project Name / Collection Address: 171324 / 801 Mill Rd

City/State/Zip: Pleasantville, NJ 08222

P.O. #: _____

Sampled By: Raheen

Well Tag # (if applicable): _____

License # (if Required): _____

Water Source: (Check One) Public Well

Well Tag # (if applicable): _____

1 Day Turnaround Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	801-1	Kitchen Prep	12-10-17	12	AM/PM	X				Temp at time of Receipt
2	-2	Kitchen Prep			AM/PM					
3	-3	Kitchen Prep			AM/PM					
4	-4	Cafe #1			AM/PM					
5	-5	Cafe #2			AM/PM					
6	-6	Cafe #3			AM/PM					
7	-7	Cafe #4			AM/PM					
8	-8	Outside Cafe #1			AM/PM					
9	-9	Outside Cafe #2			AM/PM					
10	-10	Room E112			AM/PM					

Released by: Raheen Holland

Signature: [Signature]

Date/Time: 12-11-17 11:18 AM

Released by: Phillips

Signature: [Signature]

Date/Time: RECEIVED DEC 15 2017 10:10



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324 / 801 Mill Rd

City/State/Zip: Pleasantville, NJ

P.O. #: _____ Sampled By: Rabeen Holland

License # (if Required): _____

Water Source: (Check One) Public Well Well Tag # (if Applicable): _____

~ For Lab Use Only ~
Tracking!
12 SCL 004 03
9366 5438

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	801-11	Room E112-PT-UC	12-10-07	12	AM/PM	X	-15	DRU		748678
2	-12	Room E113-UC			AM/PM					748679
3	-13	Room E113-DST-UC			AM/PM					748680
4	-14	Gym by Mens PE Office-UC			AM/PM					748681
5	-15	↓ -Rgt-UC			AM/PM					748682
6	-16	Gym by Girl Locker RM-UC			AM/PM					748283
7	-17	↓ -Rgt-UC			AM/PM					748284
8	-18	Gym by Girl Locker RM-UC			AM/PM					748285
9	-19	Gym Aux-1st-UC			AM/PM					748286
10	-20	↓ -Rgt-UC			AM/PM					748287

Released by: Rabeen Holland Signature: [Signature] Date/Time: 12-11-07 11:24

Released by: C Phillips Signature: [Signature] Date/Time: RECEIVED DEC 15 2007 10:10



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountinside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 191324 / 801 Mill Rd

City/State/Zip: Pleasantville, NJ 08224

License # (if Required):

P.O. #:

Sampled By: Robert Holland

License # (if Required):

Water Source: (Check One) Public Well

Well Tag # (if Applicable):

X	5 Day Turnaround	3 Day Turnaround	2 Day Turnaround	1 Day Turnaround	Call Ahead
---	------------------	------------------	------------------	------------------	------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	801-21	Bayan Ave - LEF - WC	12-10-07	12	AM/PM	X	-	-	-	748688
2	-22	Bayan Ave - RST - WC			AM/PM					748689
3	-23	Outside RM A103 - LEF - WC			AM/PM					748690
4	-24	Outside RM A103 - RST - WC			AM/PM					748691
5	-25	Room A104 - S			AM/PM					748692
6	-26	Library - B104 - WC			AM/PM					748693
7	-27	Room B202 - S			AM/PM					748694
8	-28	Nurse Office - WF			AM/PM					748695
9	-29	Nurse Office - WF			AM/PM					748696
10	-30	Room C181 - S			AM/PM					748697

Released by: C Phillips Signature: C Phillips Date/Time: 12-11-07 11:24
 Signature: C Phillips Date/Time: RECEIVED DEC 15 2007 10:10

UPS GROUND
 TRACKING #: 1Z 5P6 00Y 03 9405 6228



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Fax: 908-654-8069

Email: labresults@lewcorp.com
Pleasantville Middle School

Project Name / Collection Address: 101324/801 Mill Rd

City/State/Zip: Pleasantville, NJ 08859

P.O. #: _____

Sampled By: *Phoen Holland*

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

<input checked="" type="checkbox"/> 5 Day Turnaround	<input type="checkbox"/> 3 Day Turnaround	<input type="checkbox"/> 2 Day Turnaround	<input type="checkbox"/> 1 Day Turnaround	<input type="checkbox"/> Call Ahead
--	---	---	---	-------------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE Temp. - Home of BaseLab
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	SD1-31	Outside Rm C103 - LF	12-10-17	12	AM/PM	X	159	Acid		748698
2	32	Outside Rm C103 - WC			AM/PM					748699
3	33	Outside Rm C103 - LF			AM/PM					748700
4	34	↓ Outside Rm C103 - WC			AM/PM					748701
5	35	Room C205A - S			AM/PM					748702
6	36	Outside Rm A203 - LF			AM/PM					748703
7	37	Outside Rm A203 - WC			AM/PM					748704
8	38	Outside Rm A314 - LF			AM/PM					748705
9	39	Outside Rm A314 - WC			AM/PM					748706
10	40	Room B393 - S			AM/PM					748707

Released by: *Phoen Holland*

Signature: *Phoen Holland*

Date/Time: 12-11-17 11:10 AM
RECEIVED DEC 15 2017 10:10

~ For Lab Use Only ~
Tracking:
12 SF6 004 03
9405 6228



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labres@lewc.com

Fax: 908-654-8069

Project Name / Collection Address: Pleasantville Middle School

City/State/Zip: Pleasantville, NJ 08232

P.O. #: Sampled By: Raegen Holland

License # (if Required):


Water Source: (Check One) Public Well Well Tag # (if Applicable):

X	5 Day Turnaround	3 Day Turnaround	2 Day Turnaround	1 Day Turnaround - Call Ahead
---	------------------	------------------	------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of collection:	Temp. at time of collection:	
1	801-41	Outside Run C303	12-10-12	12	X					748708
2	-42	↓								748709
3	-43	Cygn by News DE OFFICE-WB								748710
4	-44	Outside gym - 5 th								748711
5	-45	↓ -25 th								748712
6	✓ -46	Swim Run								748713
7										
8										
9										
10										

Released by: Raegen Holland
 Signature: [Signature]
 Date/Time: 12-11-12 11:28 AM

Released by: Phillips
 Signature: [Signature]
 Date/Time: RECEIVED DEC 15 2012 1010

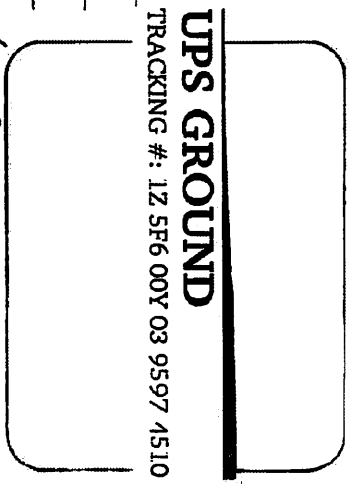

TRACKING #: 1Z SF6 00Y 03 9597 4510



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 20, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; 701 Mill Rd.; Pleasantville High School; Pleasantville, NJ 08232

Report Number: 17-12-02442

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read 'Howard Varner'. The signature is fluid and cursive, with the first name 'Howard' and last name 'Varner' clearly distinguishable.

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Report Number: 17-12-02442
 Received Date: 12/15/2017
 Reported Date: 12/20/2017
 Sampled By: Raheen Holland
 Tech Certification #:

Project/Test Address: 171324; 701 Mill Rd.; Pleasantville High School; Pleasantville, NJ 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02442-001	701-1	12/10/2017	MAIN LOBBY LFT WC	<1.00	12/18/2017	
17-12-02442-002	701-2	12/10/2017	MAIN LOBBY RGT WC	<1.00	12/18/2017	
17-12-02442-003	701-3	12/10/2017	MAIN OFFICE KITCHEN S	2.07	12/18/2017	
17-12-02442-004	701-4	12/10/2017	NURSE OFFICE NS	<1.00	12/18/2017	
17-12-02442-005	701-5	12/10/2017	NURSE OFFICE WF	9.84	12/18/2017	
17-12-02442-006	701-6	12/10/2017	NURSE OFFICE EXAM A NS	<1.00	12/18/2017	
17-12-02442-007	701-7	12/10/2017	NURSE OFFICE COL RM NS	1.34	12/18/2017	
17-12-02442-008	701-8	12/10/2017	ROOM C106 S	<1.00	12/18/2017	
17-12-02442-009	701-9	12/10/2017	ROOM C102 S	3.42	12/18/2017	
17-12-02442-010	701-10	12/10/2017	OUTSIDE RM C104 LFT WC	<1.00	12/18/2017	
17-12-02442-011	701-11	12/10/2017	OUTSIDE RM C104 RGT WC	<1.00	12/18/2017	
17-12-02442-012	701-12	12/10/2017	ROOM C104 S	10.2	12/18/2017	
17-12-02442-013	701-13	12/10/2017	ROOM B113 S	<1.00	12/18/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02442

Project/Test Address: 171324; 701 Mill Rd.; Pleasantville High School;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02442-014	701-14	12/10/2017	OUTSIDE RM B111 LFT WC	<1.00	12/18/2017	
17-12-02442-015	701-15	12/10/2017	OUTSIDE RM B111 RGT WC	<1.00	12/18/2017	
17-12-02442-016	701-16	12/10/2017	ROOM B106 S	<1.00	12/18/2017	
17-12-02442-017	701-17	12/10/2017	ROOM B105 S	<1.00	12/18/2017	
17-12-02442-018	701-18	12/10/2017	ROOM A104 S	15.0	12/18/2017	
17-12-02442-019	701-19	12/10/2017	OUTSIDE RM A103 LFT WC	19.4	12/18/2017	
17-12-02442-020	701-20	12/10/2017	OUTSIDE RM A103 RGT WC	54.6	12/18/2017	
17-12-02442-021	701-21	12/10/2017	ROOM A103 S	1.33	12/18/2017	
17-12-02442-022	701-22	12/10/2017	ROOM A107 S	<1.00	12/18/2017	
17-12-02442-023	701-23	12/10/2017	ROOM A106 LFT S	3.05	12/18/2017	
17-12-02442-024	701-24	12/10/2017	ROOM A106 RGT S	13.8	12/18/2017	
17-12-02442-025	701-26	12/10/2017	OUTSIDE CAFE LFT WC	<1.00	12/18/2017	
17-12-02442-026	701-27	12/10/2017	OUTSIDE CAFE RGT WC	<1.00	12/18/2017	
17-12-02442-027	701-28	12/10/2017	KITCHEN S	1.88	12/18/2017	
17-12-02442-028	701-29	12/10/2017	KITCHEN PREP 1 S	7.77	12/18/2017	
17-12-02442-029	701-30	12/10/2017	KITCHEN PREP 2 S	2.54	12/18/2017	
17-12-02442-030	701-31	12/10/2017	KITCHEN 1 SK	4.60	12/18/2017	
17-12-02442-031	701-32	12/10/2017	KITCHEN 2 SK	8.90	12/18/2017	
17-12-02442-032	701-33	12/10/2017	POOL WF	<1.00	12/18/2017	
17-12-02442-033	701-34	12/10/2017	GYM BELOW SIGN LFT WC	2.48	12/18/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02442

Project/Test Address: 171324; 701 Mill Rd.; Pleasantville High School;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02442-034	701-35	12/10/2017	GYM BELOW SIGN RGT WC	2.90	12/18/2017	
17-12-02442-035	701-36	12/10/2017	GYM BY EXIT DOOR LFT WC	<1.00	12/18/2017	
17-12-02442-036	701-37	12/10/2017	GYM BY EXIT DOOR RGT WC	<1.00	12/18/2017	
17-12-02442-037	701-38	12/10/2017	TRAINER'S ROOM S	1.18	12/18/2017	
17-12-02442-038	701-39	12/10/2017	TRAINER'S ROOM IM	<1.00	12/18/2017	
17-12-02442-039	701-40	12/10/2017	TEACHERS LOUNGE S	2.39	12/18/2017	
17-12-02442-040	701-41	12/10/2017	OUTSIDE RM C204 LFT WC	<1.00	12/18/2017	
17-12-02442-041	701-42	12/10/2017	OUTSIDE RM C204 RGT WC	<1.00	12/18/2017	
17-12-02442-042	701-43	12/10/2017	OUTSIDE RM B206 LFT WC	<1.00	12/18/2017	
17-12-02442-043	701-44	12/10/2017	OUTSIDE RM B206 RGT WC	<1.00	12/18/2017	
17-12-02442-044	701-45	12/10/2017	ROOM B205 S	2.18	12/18/2017	
17-12-02442-045	701-46	12/10/2017	OUTSIDE RM A205 LFT WC	<1.00	12/18/2017	
17-12-02442-046	701-47	12/10/2017	OUTSIDE RM A205 RGT WC	<1.00	12/18/2017	
17-12-02442-047	701-48	12/10/2017	ROOM A205 S	1.38	12/18/2017	
17-12-02442-048	701-49	12/10/2017	ROOM A210 S	<1.00	12/18/2017	
17-12-02442-049	701-50	12/10/2017	LIBRARY OFFICE S	7.88	12/18/2017	
17-12-02442-050	701-51	12/10/2017	ROOM F108 WF	<1.00	12/18/2017	
17-12-02442-051	701-52	12/10/2017	ROOM F109 WF	<1.00	12/18/2017	
17-12-02442-052	701-53	12/10/2017	ROOM A105 LFT S	<1.00	12/18/2017	
17-12-02442-053	701-54	12/10/2017	ROOM A105 RGT S	1.27	12/18/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 171324; 701 Mill Rd.; Pleasantville High School;
Pleasantville, NJ 08232

Report Number: 17-12-02442

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02442-054	701-55	12/10/2017	ROOM 105 S	6.75	12/18/2017	
17-12-02442-055	701	12/10/2017	LOT 2706B10	<1.00	12/18/2017	

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories™
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

17-12-02442



Due Date:
12/22/2017
(Friday)
AE

109

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road
City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068
Email: labresults@lewcorp.com
Pleasantville High School
Fax: 908-654-8069

Project Name / Collection Address: 171324 / 201 Mill Rd
City/State/Zip: Pleasantville, NJ 08232
(Required)

P.O. #: _____
Sampled By: Rabeen Holland
License # (If Required): _____

Water Source: (Check One) Public Well
(Required) Well Tag # (If Applicable): _____

<input checked="" type="checkbox"/>	5 Day Turnaround	<input type="checkbox"/>	3 Day Turnaround	<input type="checkbox"/>	2 Day Turnaround	<input type="checkbox"/>	1 Day Turnaround * Call Ahead
-------------------------------------	------------------	--------------------------	------------------	--------------------------	------------------	--------------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE Temp at Time of Receipt:
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	201-1	Main lobby - LF - WC	12-10-11	9 AM / PM	X					
2	2	Main Office Kitchen - S								
3	3	Nurse Office - NS								
4	4	Nurse Office - WF								
5	5	Nurse Office Exam - NS								
6	6	Nurse Office cot AM - NS								
7	7	Room # C106 - S								
8	8	Room # C102 - S								
9	9	Outside Rm C104 - WF								
10	10	Outside Rm C104 - WF								

Released by: Rabeen Holland
Signature: [Signature]
Date/Time: 12-11-17 11:08 PM

Released by: J Stone
Signature: [Signature]
Date/Time: 12/15/17 2:53 PM



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW Corporation Account #: 201327
Address: 1090 Bristol Road City/State/Zip: Mountainside, NJ 07092
Phone: 908-654-8068 Email: jabresults@lewcorp.com
Pleasantville High School Fax: 908-654-8069

2442

Project Name / Collection Address: 171329 / 201 Mill Rd City/State/Zip: Pleasantville, NJ 08832
(Required)
P.O. #: _____ Sampled By: Raheem Holland License # (if Required): _____

Water Source: (Check One) Public Well Well Tag # (if Applicable): _____
(Required)

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals		Field Parameters		LAB USE Temp at Time of Receipt:
					Lead	Copper	Other	Field pH at time of Collection:	
1	201-11	Outside Rm C104 - WC	12-10-17	9 AM/PM	X	-	15.4	Drain	
2	-12	Room # C104 - S		AM/PM		-			
3	-13	Room # B113 - WC		AM/PM		-			
4	-14	Outside Rm B111 - WC		AM/PM		-			
5	-15	Outside Rm B111 - WC		AM/PM		-			
6	-16	Room R106 - S		AM/PM		-			
7	-17	Room B105 - S		AM/PM		-			
8	-18	Room A104 - S		AM/PM		-			
9	-19	Outside Rm A103 - WC		AM/PM		-			
10	-20	Outside Rm A103 - WC		AM/PM		-			

Released by: Raheem Holland Signature: [Signature] Date/Time: 12-11-17 11:24 AM
Released by: T Stone Signature: [Signature] Date/Time: 12/15/17 2:53 PM



EHS Laboratories
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
 SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road
 City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068
 Email: labresults@lewcorp.com
 Pleasantville High School

Project Name / Collection Address: 171324/201 Mill Rd
 City/State/Zip: Pleasantville, NJ 08822

P.O. #: _____ Sampled By: Raheen Holland License # (If Required): _____

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters			LAB USE	
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	Temp at Time of Receipt:		
1	201-21	Room A103 - S	12-10-17	9 PM	X							
2	22	#A107 - S		AM/PM								
3	23	#A106 - S		AM/PM								
4	24	#A106 - S		AM/PM								
5		outside Cafe - WC		AM/PM								
6		outside Cafe - WC		AM/PM								
7		Kitchen - S		AM/PM								
8		Kitchen Prep #1 - S		AM/PM								
9		Kitchen Prep #2 - S		AM/PM								
10		Kitchen #1 - SK		AM/PM								

Released by: Raheen Holland Signature: _____ Date/Time: 12-11-17 9PM

Released by: TS ONE Signature: _____ Date/Time: 12/15/17 2:58 PM

2442
 ~ For Lab Use Only ~



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW Corporation
Address: 1090 Bristol Road
City/State/Zip: Mountainside, NJ 07092
Account #: 201327

Phone: 908-654-8068
Email: jlewis@lewcorp.com
Fax: 908-654-8069

Project Name / Collection Address: 171324 / 901 Mill Rd
City/State/Zip: Pleasantville, NJ 08232
P.O. #: _____
Sampled By: Rabeen Ubbland
License # (If Required): _____

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____

2442

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	201-32	Wilches #2	12-10-17	9 AM / PM	X	-	-	-	-	-
2	33	Pool								
3	34	Gym Below Sign								
4	35	Gym Below Sign								
5	36	Gym by Exit								
6	37	Gym by Exit								
7	38	Trainer's Room								
8	39	Trainer's Room								
9	40	Teacher's lounge								
10		41 Outside Run court								

Released by: Rabeen Ubbland
Signature: [Signature]
Date/Time: 12-11-17 4:19 PM

Released by: STONE
Signature: [Signature]
Date/Time: 12/15/17 2:53 PM



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW Corporation
Address: 1090 Bristol Road
Phone: 908-654-8068
Email: labresults@lewcorp.com
Project Name / Collection Address: Pleasantville High School
P.O. #: _____
City/State/Zip: Pleasantville, NJ
Account #: 201327
City/State/Zip: Mountainside, NJ 07092
Fax: 908-654-8069

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____
Sampled By: Galoon, Meland
License # (If Required): _____

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	201-41	Outside Runway WC	12-10-17	9 AM/PM	X	-1st Draw				
2	-43	Outside Runway WC		AM/PM						
3	-44	Outside Runway WC		AM/PM						
4	-45	Room # B205		AM/PM						
5	-46	Outside Runway WC		AM/PM						
6	-47	Outside Runway WC		AM/PM						
7	-48	Room A205		AM/PM						
8	-49	Room A210		AM/PM						
9	-50	Library Office		AM/PM						
10	-51	Room C108		AM/PM						

Released by: Galoon, Meland
Signature: [Signature]
Date/Time: 12-11-17 10 PM
Released by: TS + BVP
Signature: [Signature]
Date/Time: 12/15/17 2:53 PM

2442



EHS Laboratories™
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / collection Address: 171324 / 201 Mill Rd

City/State/Zip: Pleasantville, NJ 08832

P.O. #: _____

Sampled By: Palmer Holland

License # (if Required): _____

Water Source: (Check One) Public Well

Well Tag # (if Applicable): _____

<input checked="" type="checkbox"/> 5 Day Turnaround	<input type="checkbox"/> 3 Day Turnaround	<input type="checkbox"/> 2 Day Turnaround	<input type="checkbox"/> 1 Day Turnaround * Call Ahead
--	---	---	--

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	701-52	Room F109 - W/E	12-10-12	9 AM / PM	X	-	-			
2	-53	Room A105 - LFIS		9 AM / PM	-	-	-			
3	-54	Room A105 - 1st - S		9 AM / PM	-	-	-			
4	-55	Room 105 - S		9 AM / PM	-	-	-			
5				9 AM / PM	-	-	-			
6				AM / PM						
7				AM / PM						
8				AM / PM						
9				AM / PM						
10				AM / PM						

Released by: Palmer Holland Signature: _____

Signature: _____

Date/Time: 12-11-12 11:04am

Released by: TS Stone Signature: _____

Signature: _____

Date/Time: 12/15/12 2:55pm

2442



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 20, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; 175 N. Main St.; North Main School; Pleasantville, NJ 08232

Report Number: 17-12-02412

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read "Howard Varner".

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Report Number: 17-12-02412
 Received Date: 12/15/2017
 Reported Date: 12/20/2017
 Sampled By: Raheen Holland
 Tech Certification #:

Project/Test Address: 171324; 175 N. Main St.; North Main School; Pleasantville, NJ 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02412-001	175-2	12/09/2017	ROOM 122 S/F	5.57	12/18/2017	
17-12-02412-002	175-8	12/09/2017	OUTSIDE RM 115 WC	<1.00	12/18/2017	
17-12-02412-003	127-13	12/09/2017	OUTSIDE RM 104 WC	7.37	12/18/2017	
17-12-02412-004	175-15	12/09/2017	ROOM 101 S/F	8.34	12/18/2017	
17-12-02412-005	175-16	12/09/2017	ROOM 123 S/F	5.44	12/18/2017	
17-12-02412-006	175-17	12/09/2017	NURSE OFFICE NS	7.66	12/18/2017	
17-12-02412-007	175-18	12/09/2017	FACULTY RM S	2.29	12/18/2017	
17-12-02412-008	175-19	12/09/2017	ROOM 124 S/F	57.1	12/18/2017	
17-12-02412-009	175-20	12/09/2017	OUTSIDE MULTI PURPOSE RM WC	<1.00	12/18/2017	
17-12-02412-010	175-21	12/09/2017	MULTI PURPOSE RM WC	<1.00	12/18/2017	
17-12-02412-011	175-22	12/09/2017	KITCHEN S	1.45	12/18/2017	
17-12-02412-012	175-23	12/09/2017	BLANK LOT 2706B10	<1.00	12/18/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 171324; 175 N. Main St.; North Main School;
Pleasantville, NJ 08232

Report Number: 17-12-02412

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories™
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324/175 N. main st

City/State/Zip: Pleasantville, NJ 08232

P.O. #: _____

Sampled By: Raheen Holland

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	175-2	Room #102	12-9-17	2	AM/PM	X				
2	-8	Outside Rm #115-WC			AM/PM					
3	-13	Outside Rm #104-WC			AM/PM					
4	-15	Room #101			AM/PM					
5	-16	Room #123			AM/PM					
6	-17	Nurse Office			AM/PM					
7	-18	Faculty Rm			AM/PM					
8	-19	Room #104			AM/PM					
9	-20	Outside Multi Purpose Rm - WC			AM/PM					
10	-21	Multi Purpose Rm - WC			AM/PM					

Released by: Raheen Holland Signature: *[Signature]* Date/Time: 12-15-17 2:46 pm

Released by: STONE Signature: *[Signature]* Date/Time: 12-15-17 1:46 pm

17-12-02412

Due Date: 12/22/2017 (Friday) AE

[Signature]



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907

~ For Lab Use Only ~

Company Name: LEW Corporation
Address: 1090 Bristol Road
Phone: 908-654-8068
Email: labresults@lewcorp.com
City/State/Zip: Mountainside, NJ 07092
Fax: 908-654-8069

2412

Project Name / Collection Address: 171324 / 125 N. Main St
City/State/Zip: Pleasantville, NJ 08234
P.O. #: _____
Sampled By: Rabeen Holland
License # (If Required): _____

Water Source: (Check One) Public Well
Well Tag # (If Applicable): _____

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	125-22	Kitchen	12-9-23	2	AM/PM	AM/PM	AM/PM			
2	1-23									
3										
4										
5										
6										
7										
8										
9										
10										

Released by: Rabeen Holland Signature: _____
Date/Time: 12-11-23

Released by: TStone Signature: _____
Date/Time: 12/15/23 1:46 PM



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 29, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; Leeds Ave School; 100 W Leeds Ave; Pleasantville, NJ 08232

Report Number: 17-12-02434

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in blue ink that reads 'Julie Dickerson'. The signature is fluid and cursive, with the first name 'Julie' being particularly prominent.

Julie Dickerson
Laboratory Administrator
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 17-12-02434

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 12/15/2017
Reported Date: 12/29/2017
Sampled By: Raheen Holland
Tech Certification #:

Project/Test Address: 171324; Leeds Ave School; 100 W Leeds Ave; Pleasantville, NJ 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02434-001	100-1	12/09/2017	ROOM 118 LFT S	1.23	12/28/2017	
17-12-02434-002	100-2	12/09/2017	OUTSIDE RM 114 WC	<1.00	12/28/2017	
17-12-02434-003	100-3	12/09/2017	ROOM 113 S	<1.00	12/28/2017	
17-12-02434-004	100-4	12/09/2017	ROOM 110 S	2.00	12/28/2017	
17-12-02434-005	100-5	12/09/2017	OURSIDE RM 108 WC	<1.00	12/28/2017	
17-12-02434-006	100-6	12/09/2017	OUTSIDE RM 126 WC	<1.00	12/28/2017	
17-12-02434-007	100-7	12/09/2017	OUTSIDE RM 100 WC	<1.00	12/28/2017	
17-12-02434-008	100-8	12/09/2017	OUTSIDE MAIN OFFICE WC	<1.00	12/28/2017	
17-12-02434-009	100-9	12/09/2017	NURSE OFFICE NS	1.04	12/28/2017	
17-12-02434-010	100-10	12/09/2017	NURSE OFFICE BACK NS	<1.00	12/28/2017	
17-12-02434-011	100-11	12/09/2017	MAIN OFFICE KT S	4.91	12/28/2017	
17-12-02434-012	100-12	12/09/2017	MAIN OFFICE BY OVEN S	6.48	12/28/2017	
17-12-02434-013	100-13	12/09/2017	ROOM 207 S	15.4	12/28/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 17-12-02434

Project/Test Address: 171324; Leeds Ave School; 100 W Leeds Ave;
Pleasantville, NJ 08232

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02434-014	100-14	12/09/2017	OUTSIDE RM 204 WC	<1.00	12/28/2017	
17-12-02434-015	100-15	12/09/2017	OUTSIDE RM 201 WC	<1.00	12/28/2017	
17-12-02434-016	100-16	12/09/2017	ROOM 308 WC	<1.00	12/28/2017	
17-12-02434-017	100-17	12/09/2017	OUTSIDE RM 310 WC	<1.00	12/28/2017	
17-12-02434-018	100-18	12/09/2017	3RD FL BOYS & GIRL BATH WC	<1.00	12/28/2017	
17-12-02434-019	100-19	12/09/2017	OUTSIDE RM 300 WC	<1.00	12/28/2017	
17-12-02434-020	100-20	12/09/2017	GYM LFT WC	<1.00	12/28/2017	
17-12-02434-021	100-21	12/09/2017	GYM RGT WC	<1.00	12/28/2017	
17-12-02434-022	100-22	12/09/2017	KITCHEN SK	7.76	12/28/2017	
17-12-02434-023	100-23	12/09/2017	KITCHEN MIDDLE S	9.60	12/28/2017	
17-12-02434-024	100-24	12/09/2017	KITCHEN BACK WALL S	10.5	12/28/2017	
17-12-02434-025	100-25	12/09/2017	OUTSIDE CAFE WC	<1.00	12/28/2017	
17-12-02434-026	100-26	12/09/2017	TEACHERS LOUNGE S	5.29	12/28/2017	
17-12-02434-027	100-27	12/09/2017	OUTSIDE STORAGE RM A LFT WC	<1.00	12/28/2017	
17-12-02434-028	100-28	12/09/2017	OUTSIDE STORAGE RM A RGT WC	<1.00	12/28/2017	
17-12-02434-029	100-29	12/09/2017	ROOM 403 S/F	4.15	12/28/2017	
17-12-02434-030	100-30	12/09/2017	ROOM 401 S/F	1.68	12/28/2017	
17-12-02434-031	100-31	12/09/2017	ROOM 402 S/F	1.83	12/28/2017	
17-12-02434-032	100-32	12/09/2017	ROOM 404 S/F	2.02	12/28/2017	
17-12-02434-033	100-33	12/09/2017	MAIN LOBBY LFT WC	<1.00	12/28/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 171324; Leeds Ave School; 100 W Leeds Ave;
 Pleasantville, NJ 08232

Report Number: 17-12-02434

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02434-034	100-34	12/09/2017	MAIN LOBBY RGT WC	<1.00	12/28/2017	
17-12-02434-035	100-35	12/09/2017	OUTSIDE RM 200 WC	<1.00	12/28/2017	
17-12-02434-036	100-36	12/09/2017	OUTSIDE RM 304 WC	<1.00	12/28/2017	
17-12-02434-037	100-37	12/09/2017	SUN ROOM S	<1.00	12/28/2017	
17-12-02434-038	100-8 DUPLICAT E	12/09/2017	OUTSIDE MAIN OFFICE WC	<1.00	12/28/2017	

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Missy Kanode
 QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
 SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

17-12-02434



Due Date:
01/02/2018
 (Tuesday)
 AE

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road
 City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068
 Email: labresults@lewcorp.com
 Fax: 908-654-8069

Project Name / Collection Address: 171324/100 W. Leeds Ave
 City/State/Zip: Pleasantville, NJ 08212

P.O. #: _____
 Sampled By: Rakhen Holland
 License # (If Required): _____

Water Source: (Check One) Public Well
 Well Tag # (If Applicable): _____

<input checked="" type="checkbox"/>	5 Day Turnaround	<input type="checkbox"/>	3 Day Turnaround	<input type="checkbox"/>	2 Day Turnaround	<input type="checkbox"/>	1 Day Turnaround * Call Ahead
-------------------------------------	------------------	--------------------------	------------------	--------------------------	------------------	--------------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals		Field Parameters		LAB USE
					Lead	Copper	Field pH at time of Collection:	Temp. at time of Collection:	
1	100-1	Room #118 - CFT - S	12-9-17	10 AM/PM	X				
2	-2	Outside RM #114 - WC		AM/PM					
3	-3	Room #113 - S		AM/PM					
4	-4	Room #110 - S		AM/PM					
5	-5	Outside RM #108 - WC		AM/PM					
6	-6	Outside RM #126 - WC		AM/PM					
7	-7	Outside RM #100 - WC		AM/PM					
8	-8	Outside main office - WC		AM/PM					
9	-9	Nurse office - NS		AM/PM					
10	-10	Nurse office - Back - NS		AM/PM					

Released by: Rakhen Holland Signature: _____ Date/Time: 12-11-17 11:6 AM
 Released by: TSONE Signature: _____ Date/Time: 12/15/17 2:40 PM
 12 MW 9383 6758 9648
 UNIDENTIFIED SAMPLES REC. 12/21/17
 ADD EXTRA TAGS TO END
 GS



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: 171324/100 W. Leeds Ave

City/State/Zip: Plainsboro, NJ 08522

P.O. #: _____ Sampled By: Rabeen Holland

License # (If Required): _____

Water Source: (Check One) Public Well

Well Tag # (If Applicable): _____

X 5 Day Turnaround 3 Day Turnaround 2 Day Turnaround 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of collection:	Temp. at time of collection:	
1	100-11	Main office Kit - S	12-9-12	10 AM/PM	X					
2	12	Main office by over - S		AM/PM						
3	13	Room # 207 - S		AM/PM						
4	14	Outside RM # 204 - WC		AM/PM						
5	15	Outside RM # 201 - WC		AM/PM						
6	16	Room # 308 - WC		AM/PM						
7	17	Outside RM # 310 - WC		AM/PM						
8	18	3rd Fl Boys & Girl Bath - WC		AM/PM						
9	19	Outside RM # 300 - WC		AM/PM						
10	20	Gym - LFT - WC		AM/PM						

Released by: Rabeen Holland Signature: [Signature] Date/Time: 12-11-12 11:00 PM

Released by: STONE Signature: [Signature] Date/Time: 12-11-12 2:40 PM

~ For Lab Use Only ~
2434



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

~ For Lab Use Only ~

Company Name: LEW Corporation

Account #: 201327

Address: 1090 Bristol Road

City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Leeds Ave School

Project Name / Collection Address: 121324/100 W. Leeds Ave

City/State/Zip: Pleasantville, NJ 08122

P.O. #: _____ Sampled By: Rabeen Holland

License # (If Required): _____

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____

<input checked="" type="checkbox"/>	5 Day Turnaround	<input type="checkbox"/>	3 Day Turnaround	<input type="checkbox"/>	2 Day Turnaround	<input type="checkbox"/>	1 Day Turnaround * Call Ahead
-------------------------------------	------------------	--------------------------	------------------	--------------------------	------------------	--------------------------	-------------------------------

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	100-21	Gym - Rgt	12-9-17	10:00 AM	X	-	-	-	-	1st Draw
2	-22	Kitchen		AM/PM						
3	95	Kitchen Mibble - S		AM/PM						
4	-24	Kitchen Back wall - S		AM/PM						
5	-25	Outside Cafe - WC		AM/PM						
6	-26	Teachers Lounge - S		AM/PM						
7	-27	Outside Storage Rm-A - WC		AM/PM						
8	-28	Outside Storage Rm-A - WC		AM/PM						
9	-29	Room #403 - SIF		AM/PM						
10	-30	Room #401 - SIF		AM/PM						

Released by: Rabeen Holland

Signature: _____

Date/Time: 12-11-17 11:00 AM

Released by: Stone

Signature: _____

Date/Time: 12/15/17 2:40 PM



EHS Laboratories
 ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd, Richmond, VA 23237
 Phone: (800) 347-4010 FAX: (804) 275-4907
 ENVIRONMENTAL PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

UPS GROUND

TRACKING #: 1Z 5F6 00Y 03 9752 8703

Company Name: LEW Corporation Account #: 201327
 Address: 1090 Bristol Road City/State/Zip: Mountainside, NJ 07092

Phone: 908-654-8068 Email: labresults@lewcorp.com Fax: 908-654-8069

Project Name / Collection Address: 121324 / 100 W. Leeds Ave City/State/Zip: Pleasantville, NJ 08232
 (Required)

P.O. #: _____ Sampled By: Raheem Holland License # (If Required): _____

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____
 (Required)

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	100-31	Room #402	12-11-07	10 AM	X					7418609
2	-32	Room #404		AM/PM						7416810
3	-33	Main lobby-LF		AM/PM						7418811
4	-34	Main lobby-RF		AM/PM						7416812
5	-35	Outside Rm #300-WC		AM/PM						7416813
6	-36	Outside Rm #304-WC		AM/PM						7416814
7	-39	Son Room		AM/PM						7416815
8	38			AM/PM						
9	Duplicate #8	ADD TO END		AM/PM						
10				AM/PM						

Released by: Raheem Holland Signature: [Signature] Date/Time: 12-11-07 6 PM
 Released by: C Phillips Signature: [Signature] RECEIVED DEC 15 2007 1010



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

December 20, 2017

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

Project/Test Address: 171324; 115 W. Decatur Ave.; Decatur Ave. School; Pleasantville, NJ 08232

Report Number: 17-12-02427

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read 'Howard Varner'. The signature is fluid and cursive, with the first name 'Howard' and last name 'Varner' clearly distinguishable.

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
 7469 Whitepine Rd
 Richmond, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 17-12-02427

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 12/15/2017
 Reported Date: 12/20/2017
 Sampled By: Raheen Holland
 Tech Certification #:

Project/Test Address: 171324; 115 W. Decatur Ave.; Decatur Ave. School; Pleasantville, NJ 08232

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
17-12-02427-001	115-1	12/09/2017	OUTSIDE CAFE WC	1.90	12/19/2017	
17-12-02427-002	115-2	12/09/2017	KITCHEN S	19.0	12/19/2017	
17-12-02427-003	115-3	12/09/2017	OUTSIDE TEACHERS LOUNGE WC	<1.00	12/19/2017	
17-12-02427-004	115-4	12/09/2017	NURSE OFFICE NS	4.27	12/19/2017	
17-12-02427-005	115	12/09/2017	LOT 2706B10	<1.00	12/19/2017	
17-12-02427-006	115-5	12/09/2017	OUTSIDE MAIN OFFICE WC	<1.00	12/19/2017	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 171324; 115 W. Decatur Ave.; Decatur Ave. School;
Pleasantville, NJ 08232

Report Number: 17-12-02427

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories™
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



17-12-02427

Company Name: LEW Corporation
Address: 1090 Bristol Road
Phone: 908-654-8068
Email: labresults@lewcorp.com
City/State/Zip: Mountainside, NJ 07092
Account #: 201327

Project Name / Collection Address: 171324/115 W. Decatur Ave
City/State/Zip: Pleasantville, NJ 08132
P.O. #: _____
Sampled By: Raheen Holland
License # (If Required): _____

Water Source: (Check One) Public Well Well Tag # (If Applicable): _____

Released by: Raheen Holland
Signature: [Signature]
Date/Time: 12-11-12 11:00 AM

Released by: J Stone
Signature: [Signature]
Date/Time: 12/15/12 2:30 PM

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE Temp at Time of Receipt:
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	115-1	Outside Cafe	12-9-12	3 AM/PM	X	-15%	Draw			
2	-2	Kitchen		AM/PM						
3	-3	Outside Teachers lounge		AM/PM						
4	-4	Nurse office		AM/PM						
5	-5	Outside Main office		AM/PM						
6				AM/PM						
7				AM/PM						
8				AM/PM						
9				AM/PM						
10				AM/PM						

Turnaround options: 5 Day Turnaround, 3 Day Turnaround, 2 Day Turnaround, 1 Day Turnaround * Call Ahead

Due Date: 12/22/2017 (Friday)
AE

GR

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Decatur Ave School	12/9/2017	12/19/2017	115-1	Outside Café -WC	1.90
Decatur Ave School	12/9/2017	12/19/2017	115-2	Kitchen -S	19
Decatur Ave School	12/9/2017	12/19/2017	115-3	Outside Teachers Lounge -WC	<1.00
Decatur Ave School	12/9/2017	12/19/2017	115-4	Nurse Office -NS	4.27
Decatur Ave School	12/9/2017	12/19/2017	115-5	Outside Main Office -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-2	Main Office -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-4	Outside Room 105B Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-5	Outside Room 105B Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-6	Faculty Room -S	4.79
Washington Ave Schd	12/9/2017	12/19/2017	225-7	Outside Electric Room Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-8	Outside Electric Room Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-9	Gym -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-10	Café Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-11	Café Rgt -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-12	Kitchen -Prep Sink	15.90
Washington Ave Schd	12/9/2017	12/19/2017	225-13	Kitchen -SK	229
Washington Ave Schd	12/9/2017	12/19/2017	225-14	Outside Art Room Lft -WC	<1.00
Washington Ave Schd	12/9/2017	12/19/2017	225-15	Outside Art Room Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-1	Room #118 Lft -S	1.23
Leeds Ave School	12/9/2017	12/28/2017	100-2	Outside Room #114 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-3	Room #113 -S	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-4	Room #110 -S	2
Leeds Ave School	12/9/2017	12/28/2017	100-5	Outside Room #108 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-6	Outside Room #126 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-7	Outside Room #100 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-8	Outside Main Office -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-9	Nurse Office -NS	1.04
Leeds Ave School	12/9/2017	12/28/2017	100-10	Nurse Office Back -NS	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-11	Main Office Kitchen -S	4.91
Leeds Ave School	12/9/2017	12/28/2017	100-12	Main Office By Oven -S	6.48
Leeds Ave School	12/9/2017	12/28/2017	100-13	Room #207-S	15.40
Leeds Ave School	12/9/2017	12/28/2017	100-14	Outside Room #204-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-15	Outside Room #201 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-16	Room #308 -WC	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Leeds Ave School	12/9/2017	12/28/2017	100-17	Outside Room #310 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-18	3rd Flr Boys & Girls Bath -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-19	Outside Rm #300 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-20	Gym Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-21	Gym Rgt -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-22	Kitchen -SK	7.76
Leeds Ave School	12/9/2017	12/28/2017	100-23	Kitchen Middle -S	9.6
Leeds Ave School	12/9/2017	12/28/2017	100-24	Kitchen Back Wall -S	10.5
Leeds Ave School	12/9/2017	12/28/2017	100-25	Outside Café -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-26	Teachers Lounge -S	5.29
Leeds Ave School	12/9/2017	12/28/2017	100-27	Outside Storage Rm A Lft-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-28	Outside Storage Rm A Rgt-WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-29	Room #403 -S/F	4.15
Leeds Ave School	12/9/2017	12/28/2017	100-30	Room #401 -S/F	1.68
Leeds Ave School	12/9/2017	12/28/2017	100-31	Room #402 -S/F	1.83
Leeds Ave School	12/9/2017	12/28/2017	100-32	Room #404 -S/F	2.02
Leeds Ave School	12/9/2017	12/28/2017	100-33	Main Lobby Lft -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-34	Main Lobby Rgt -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-35	Outside Rm #200 -WC	<1.00
Leeds Ave School	12/9/2017	12/28/2017	100-36	Outside #304 -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-2	Room #122 -S/F	5.57
N. Main St School	12/9/2017	12/18/2017	175-8	Outside Rm #115 -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-13	Outside Rm #104 -WC	7.37
N. Main St School	12/9/2017	12/18/2017	175-15	Room #101 -S/F	8.34
N. Main St School	12/9/2017	12/18/2017	175-16	Room #123 -S/F	5.44
N. Main St School	12/9/2017	12/18/2017	175-17	Nurse Office -NS	7.66
N. Main St School	12/9/2017	12/18/2017	175-18	Faculty Rm -S	2.29
N. Main St School	12/9/2017	12/18/2017	175-19	Room #124 -S/F	57.10
N. Main St School	12/9/2017	12/18/2017	175-20	Outside Muti-Purpose Rm -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-21	Muti Purpose Rm -WC	<1.00
N. Main St School	12/9/2017	12/18/2017	175-22	Kithen -S	1.45
S. Main St School	12/9/2017	12/19/2017	701S-1	Room #121 -S/F	5.55
S. Main St School	12/9/2017	12/19/2017	701S-2	Room #124 -S/F	2.47
S. Main St School	12/9/2017	12/19/2017	701S-3	Room #120 -S/F	5.59

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
S. Main St School	12/9/2017	12/19/2017	701S-4	Main Office -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-5	Nurse Office -NS	4.04
S. Main St School	12/9/2017	12/19/2017	701S-6	Nurse Office -NS	2.96
S. Main St School	12/9/2017	12/19/2017	701S-7	Room #128 -S/F	2.21
S. Main St School	12/9/2017	12/19/2017	701S-9	Room #129 -S/F	13.90
S. Main St School	12/9/2017	12/19/2017	701S-10	Outside Rm #110 -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-11	Outside Rm #106 Lft -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-12	Outside Rm #106 Rgt -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-13	Outside Rm #102 -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-14	Café Lft -WC	1.01
S. Main St School	12/9/2017	12/19/2017	701S-15	Café Rgt -WC	1.04
S. Main St School	12/9/2017	12/19/2017	701S-16	Kitchen -S	5.14
S. Main St School	12/9/2017	12/19/2017	701S-17	Kitchen SK	4.16
S. Main St School	12/9/2017	12/19/2017	701S-18	Gym -WC	5.21
S. Main St School	12/9/2017	12/19/2017	701S-19	Outside Faculty Lounge Lft-WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-20	Outside Faculty Lounge Rgt-WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-21	Faculty Lounge -S	4.21
S. Main St School	12/9/2017	12/19/2017	701S-22	Room #201 -S/F	6.98
S. Main St School	12/9/2017	12/19/2017	701S-24	Room #202 -S/F	3
S. Main St School	12/9/2017	12/19/2017	701S-25	Room #218 -S/F	1.84
S. Main St School	12/9/2017	12/19/2017	701S-26	Outside Rm #203 Lft -WC	<1.00
S. Main St School	12/9/2017	12/19/2017	701S-28	Room #203 -S/F	2.20
S. Main St School	12/9/2017	12/19/2017	701S-29	Room #205 -S/F	1.62
S. Main St School	12/9/2017	12/19/2017	701S-30	Room #206 -S/F	3.84
S. Main St School	12/9/2017	12/19/2017	701S-31	Room #210 -S/F	3.8
S. Main St School	12/9/2017	12/19/2017	701S-32	Room #207 -S/F	3.11
S. Main St School	12/9/2017	12/19/2017	701S-33	Room #209 -S/F	2.04
S. Main St School	12/9/2017	12/19/2017	701S-35	Library Office -S	7.08
S. Main St School	12/9/2017	12/19/2017	701S-36	Outside Rm #203 Rgt -WC	<1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-1	Kitchen Prep -S	8.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-2	Kitchen Prep -S	8.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-3	Kitchen Prep -IM	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-4	Café #1 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-5	Café #2 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-6	Café #3 -WC	ND

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Pleasantville Middle S	12/10/2017	12/20/2017	801-7	Café #4 -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-8	Outside Café Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-9	Outside Café Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-10	Room E112 Lft -WC	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-11	Room E112 Rgt -WC	3.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-12	Room E113 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-13	Room E113 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-14	Gym By Mens PE Office Lft-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-15	Gym By Mens PE Office Rgt-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-16	Gym By Girls Locker Rm Lft-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-17	Gym By Girls Locker Rm Rgt-WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-18	Gym By Girls Locker Rm -WB	1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-19	Gym Aux Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-20	Gym Aux Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-21	Gym Aux Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-22	Gym Aux Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-23	Outside Rm A103 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-24	Outside Rm A103 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-25	Room A104 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-26	Library B104 -WF	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-27	Room B102C -S	15.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-28	Nurse Office -WF	1.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-29	Nurse Office -NS	10.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-30	Room C121 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-31	Outside Rm C103 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-32	Outside Rm C103 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-33	Outside Rm C203 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-34	Outside Rm C203 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-35	Room C205A -S	17.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-36	Outside Rm A203 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-37	Outside Rm A203 Rgt -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-38	Outside Rm A314 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-39	Outside Rm A314 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-40	Room B303 -S	2.00
Pleasantville Middle S	12/10/2017	12/20/2017	801-41	Outside Rm C303 Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-42	Outside Rm C303 Lft -WC	ND

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Pleasantville Middle S	12/10/2017	12/20/2017	801-43	Gym By Mens PE Office -WB	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-44	Outside Gym Lft -WC	ND
Pleasantville Middle S	12/10/2017	12/20/2017	801-45	Outside Gym Lft -WC	ND
Pleasantville High Sci	12/10/2017	12/18/2017	701-1	Main Lobby -Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-2	Main Lobby -Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-3	Main Lobby Kitchen -S	2.07
Pleasantville High Sci	12/10/2017	12/18/2017	701-4	Nurse Office -NS	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-5	Nurse Office -WF	9.84
Pleasantville High Sci	12/10/2017	12/18/2017	701-6	Nurse Office Exam Rm A-NS	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-7	Nurse Office Col Rm -NS	1.34
Pleasantville High Sci	12/10/2017	12/18/2017	701-8	Room C106 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-9	Room C102 -S	3.42
Pleasantville High Sci	12/10/2017	12/18/2017	701-10	Outside Rm C104 Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-11	Outside Rm C104 Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-12	Room C104 -S	10.20
Pleasantville High Sci	12/10/2017	12/18/2017	701-13	Room B113 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-14	Outside B111 Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-15	Outside B111 Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-16	Room B106 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-17	Room B105 -S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-18	Room A104 -S	15.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-19	Outside Rm A103 Lft -WC	19.40
Pleasantville High Sci	12/10/2017	12/18/2017	701-20	Outside Rm A103 Rg t -WC	54.60
Pleasantville High Sci	12/10/2017	12/18/2017	701-21	Room A103 -S	1.33
Pleasantville High Sci	12/10/2017	12/18/2017	701-22	Room A107 S	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-23	Room A106 Lft -S	3.05
Pleasantville High Sci	12/10/2017	12/18/2017	701-24	Room A106 Rgt -S	13.80
Pleasantville High Sci	12/10/2017	12/18/2017	701-26	Outside Caf� Lft -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-27	Outside Caf� Rgt -WC	<1.00
Pleasantville High Sci	12/10/2017	12/18/2017	701-28	Kitchen -S	1.88
Pleasantville High Sci	12/10/2017	12/18/2017	701-29	Kitchen Prep 1 -S	7.77
Pleasantville High Sci	12/10/2017	12/18/2017	701-30	Kitchen Prep 2 -S	2.54
Pleasantville High Sci	12/10/2017	12/18/2017	701-31	Kitchen 1 -SK	4.60
Pleasantville High Sci	12/10/2017	12/18/2017	701-32	Kitchen 2 -SK	8.90
Pleasantville High Sci	12/10/2017	12/18/2017	701-33	Pool -WF	<1.00

